


LITTLETON WATER DEPARTMENT



TAYLOR STREET WELL AND RAW WATER MAIN TOWN CONTRACT NO. IFB-2024 DWSRF NO. 12397 - CONTRACT NO.1 NICK LAWLER - GENERAL MANAGER DAVE KETCHEN - ASSISTANT GENERAL MANAGER COREY GODFREY - WATER SUPERINTENDENT

DRAWING INDEX	
SHEET	TITLE
G000	COVER AND SHEET LIST
G001	ABBREVIATIONS, NOTES, AND LEGEND
C101	RAW WATER PLAN WHITCOMB AVENUE
C102	RAW WATER PLAN WHITCOMB AVENUE
C103	RAW WATER PLAN CROSS COUNTRY
C104	ACCESS ROAD GRADING & DRAINAGE PLAN
C105	ACCESS ROAD GRADING & DRAINAGE PLAN
C201	BEAVER BROOK DIRECTIONAL DRILL
C501	DETAILS I
C502	DETAILS II
C503	DETAILS III
C504	DETAILS IV

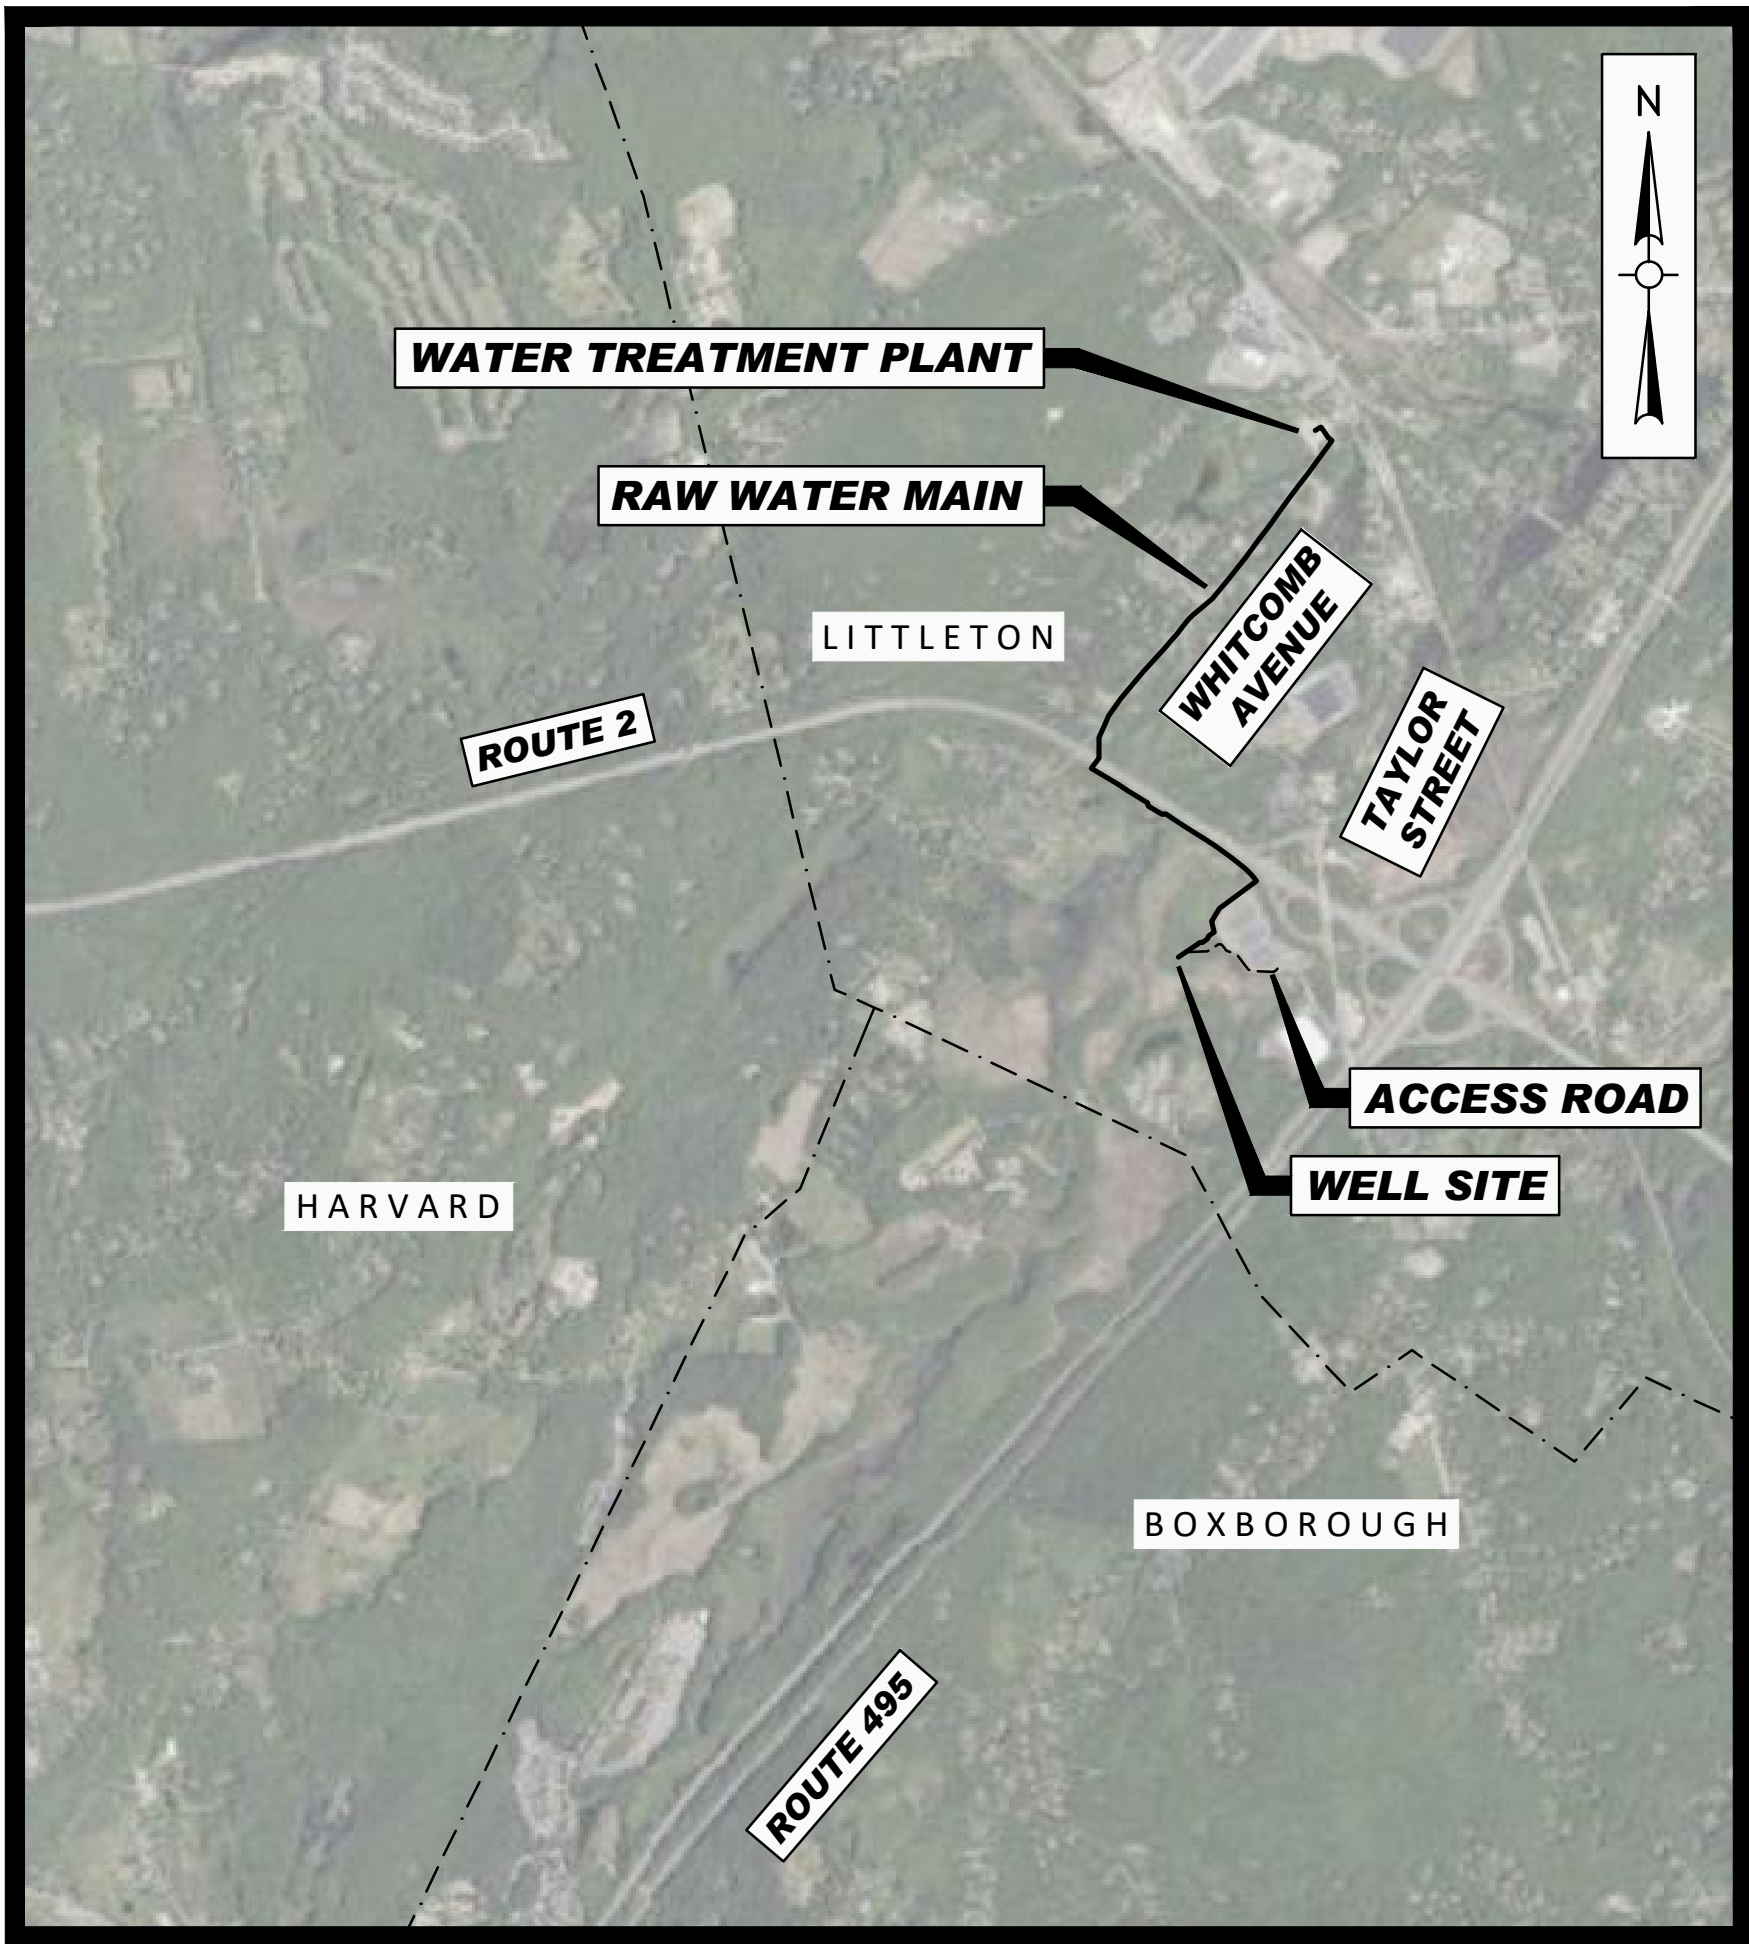

LOCUS MAP
SCALE : 1"=2000'

Weston & Sampson
Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com


Issued Date: **OCTOBER 2023**

Seal:

811
Know what's below.
Call before you dig.

TARA E. MC MANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For: **FOR PERMIT REVIEW**

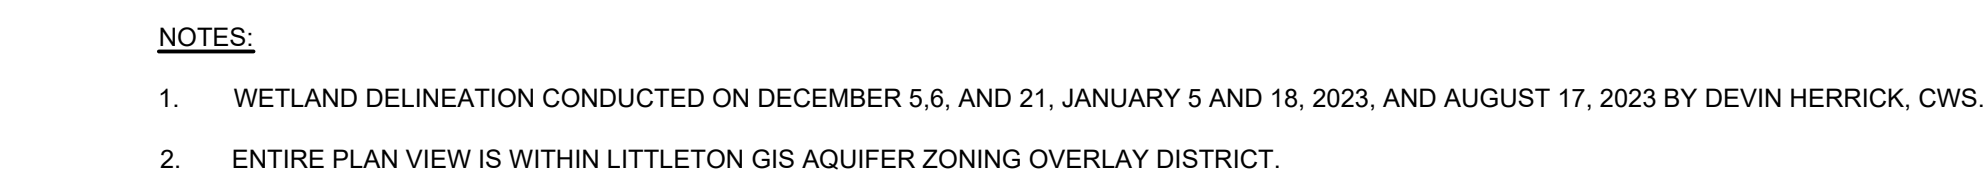

COA:


Seal:




The seal is circular with a double-lined border. The outer ring contains the text "COMMONWEALTH OF MASSACHUSETTS" at the top and "PROFESSIONAL ENGINEER" at the bottom. The center of the seal contains the text "TARA E MCMANUS" in a bold, sans-serif font, followed by "No. 57127" and "REGISTERED" in a smaller font, and "PROFESSIONAL ENGINEER" in a bold, sans-serif font at the bottom. Below the seal is a handwritten signature in cursive script that reads "Tara E. McManus".

Drawing Title:


RAW WATER PLAN
WHITCOMB AVENUE

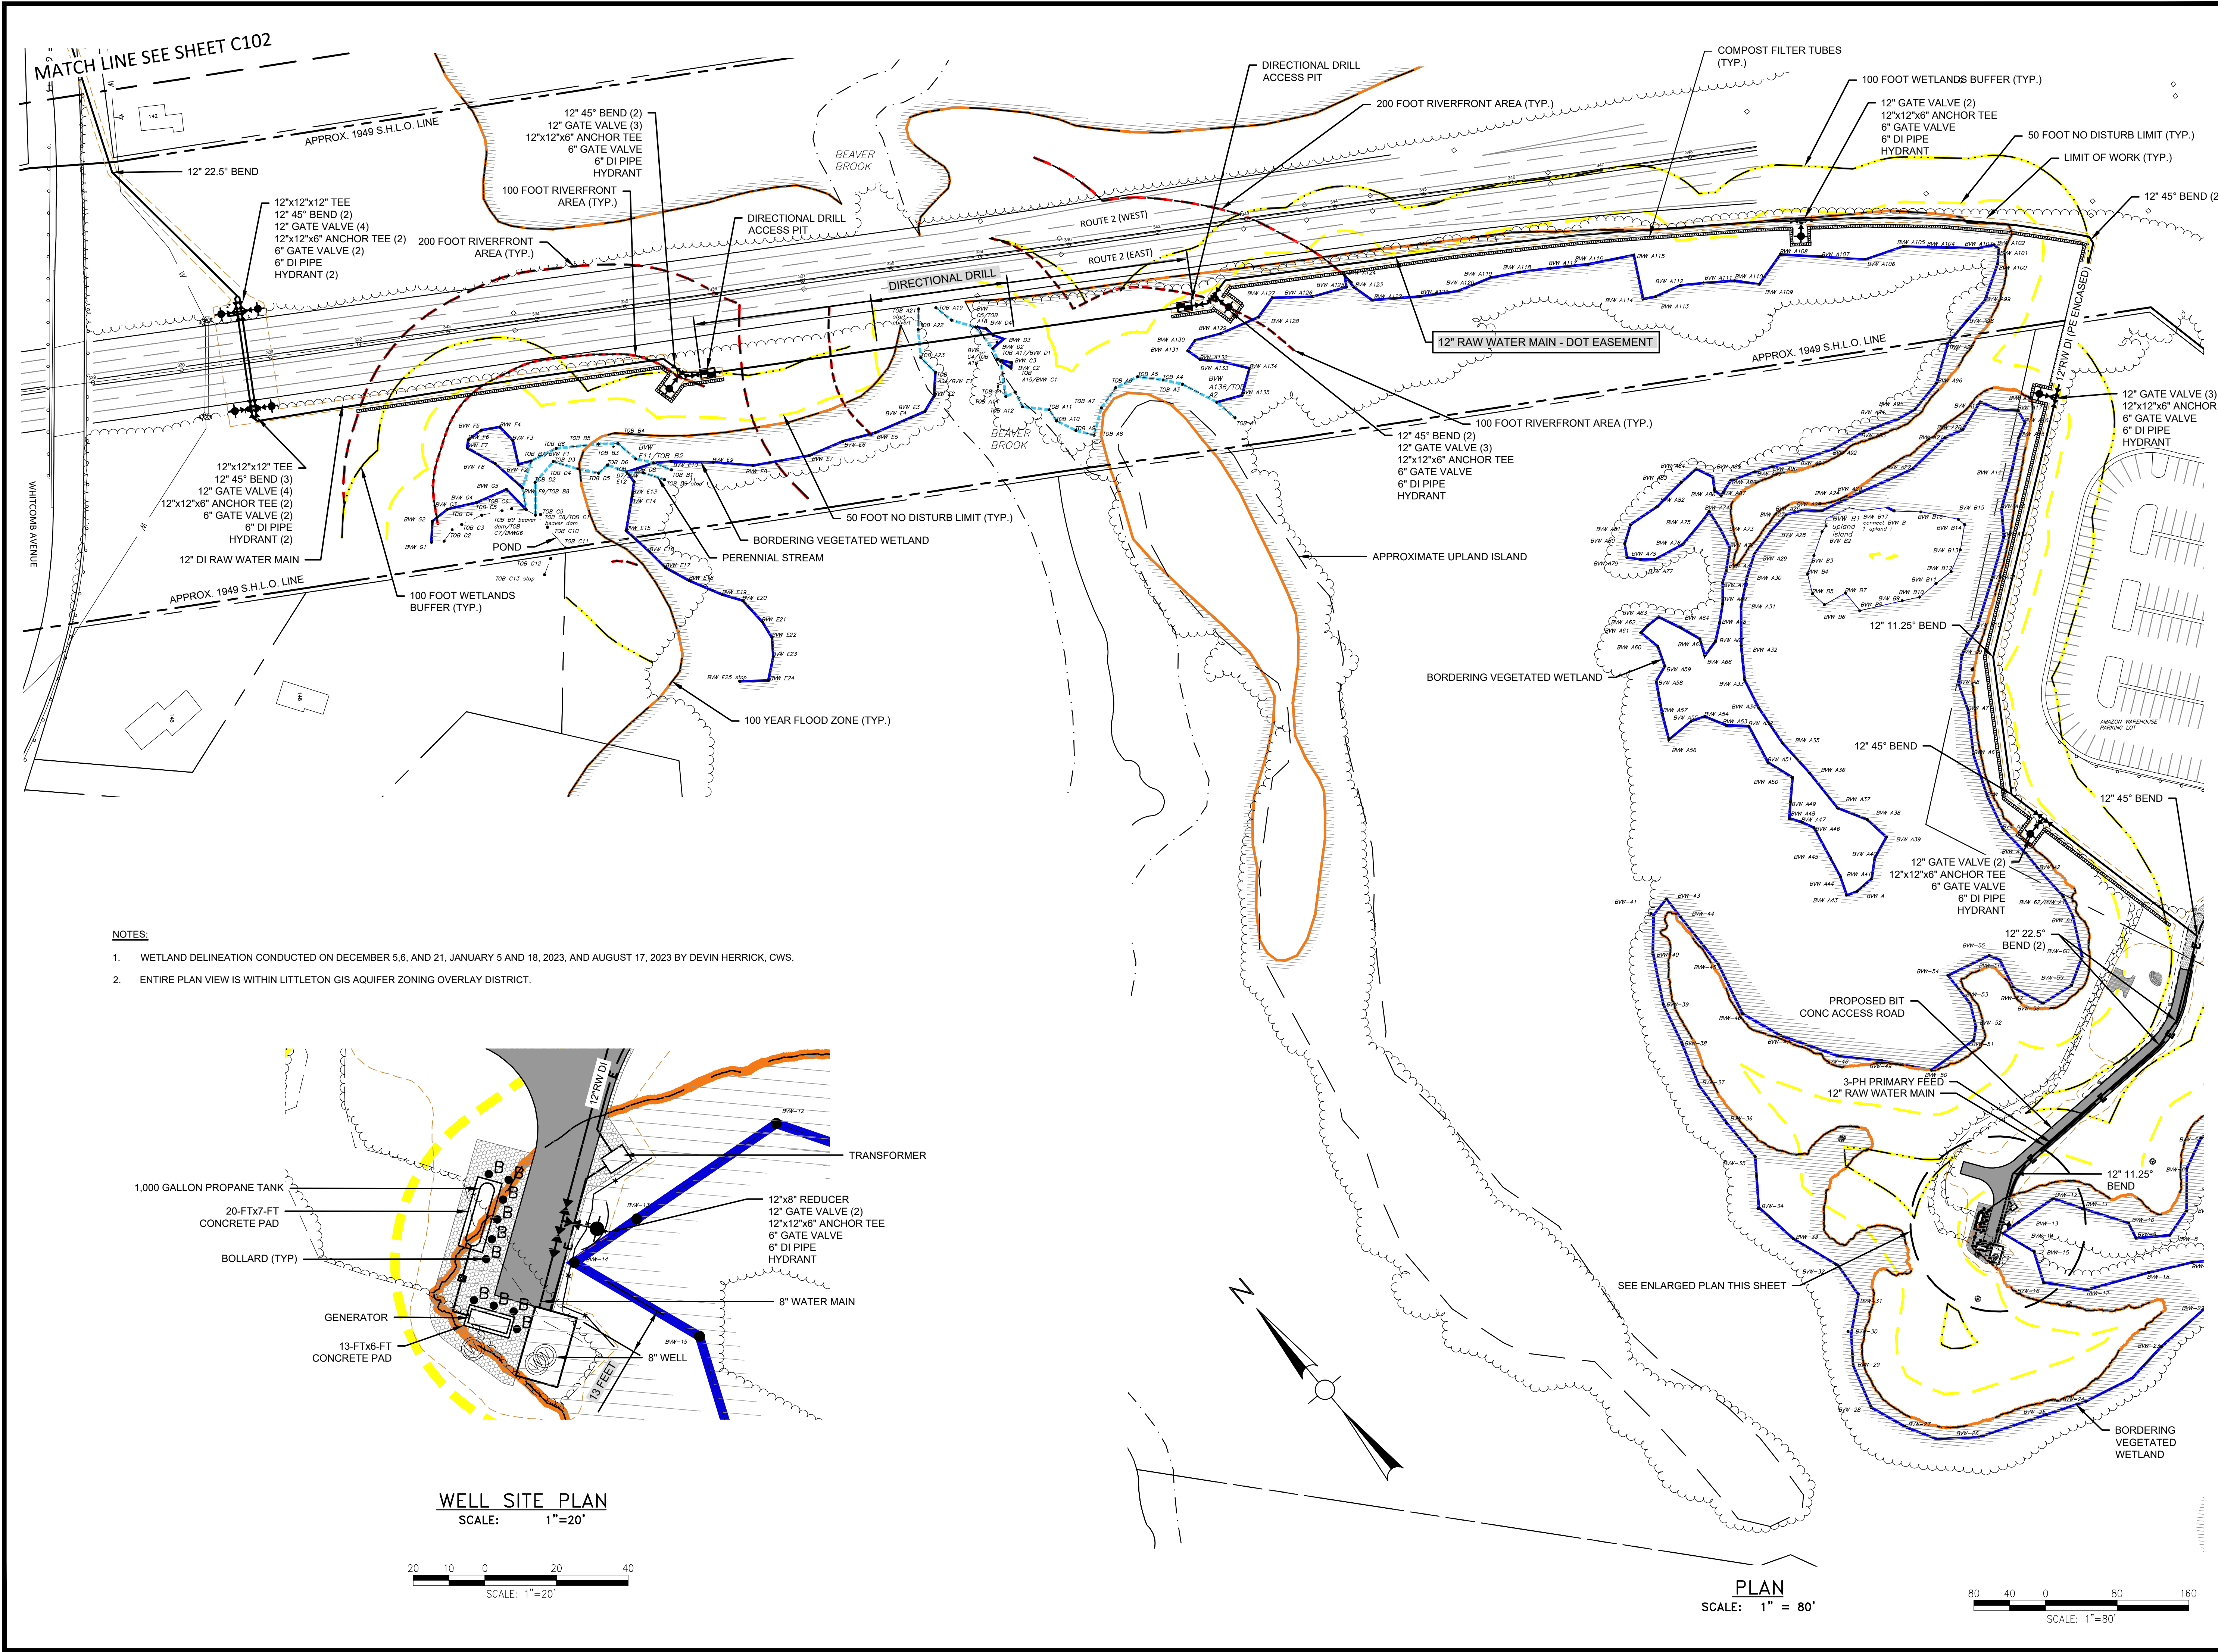

- NOTES:
1. WETLAND DELINEATION CONDUCTED ON DECEMBER 5, 6, AND 21, JANUARY 5 AND 18, 2023, AND AUGUST 17, 2023 BY DEVIN HERRICK, CWS.
 2. ENTIRE PLAN VIEW IS WITHIN LITTLETON GIS AQUIFER ZONING OVERLAY DISTRICT.

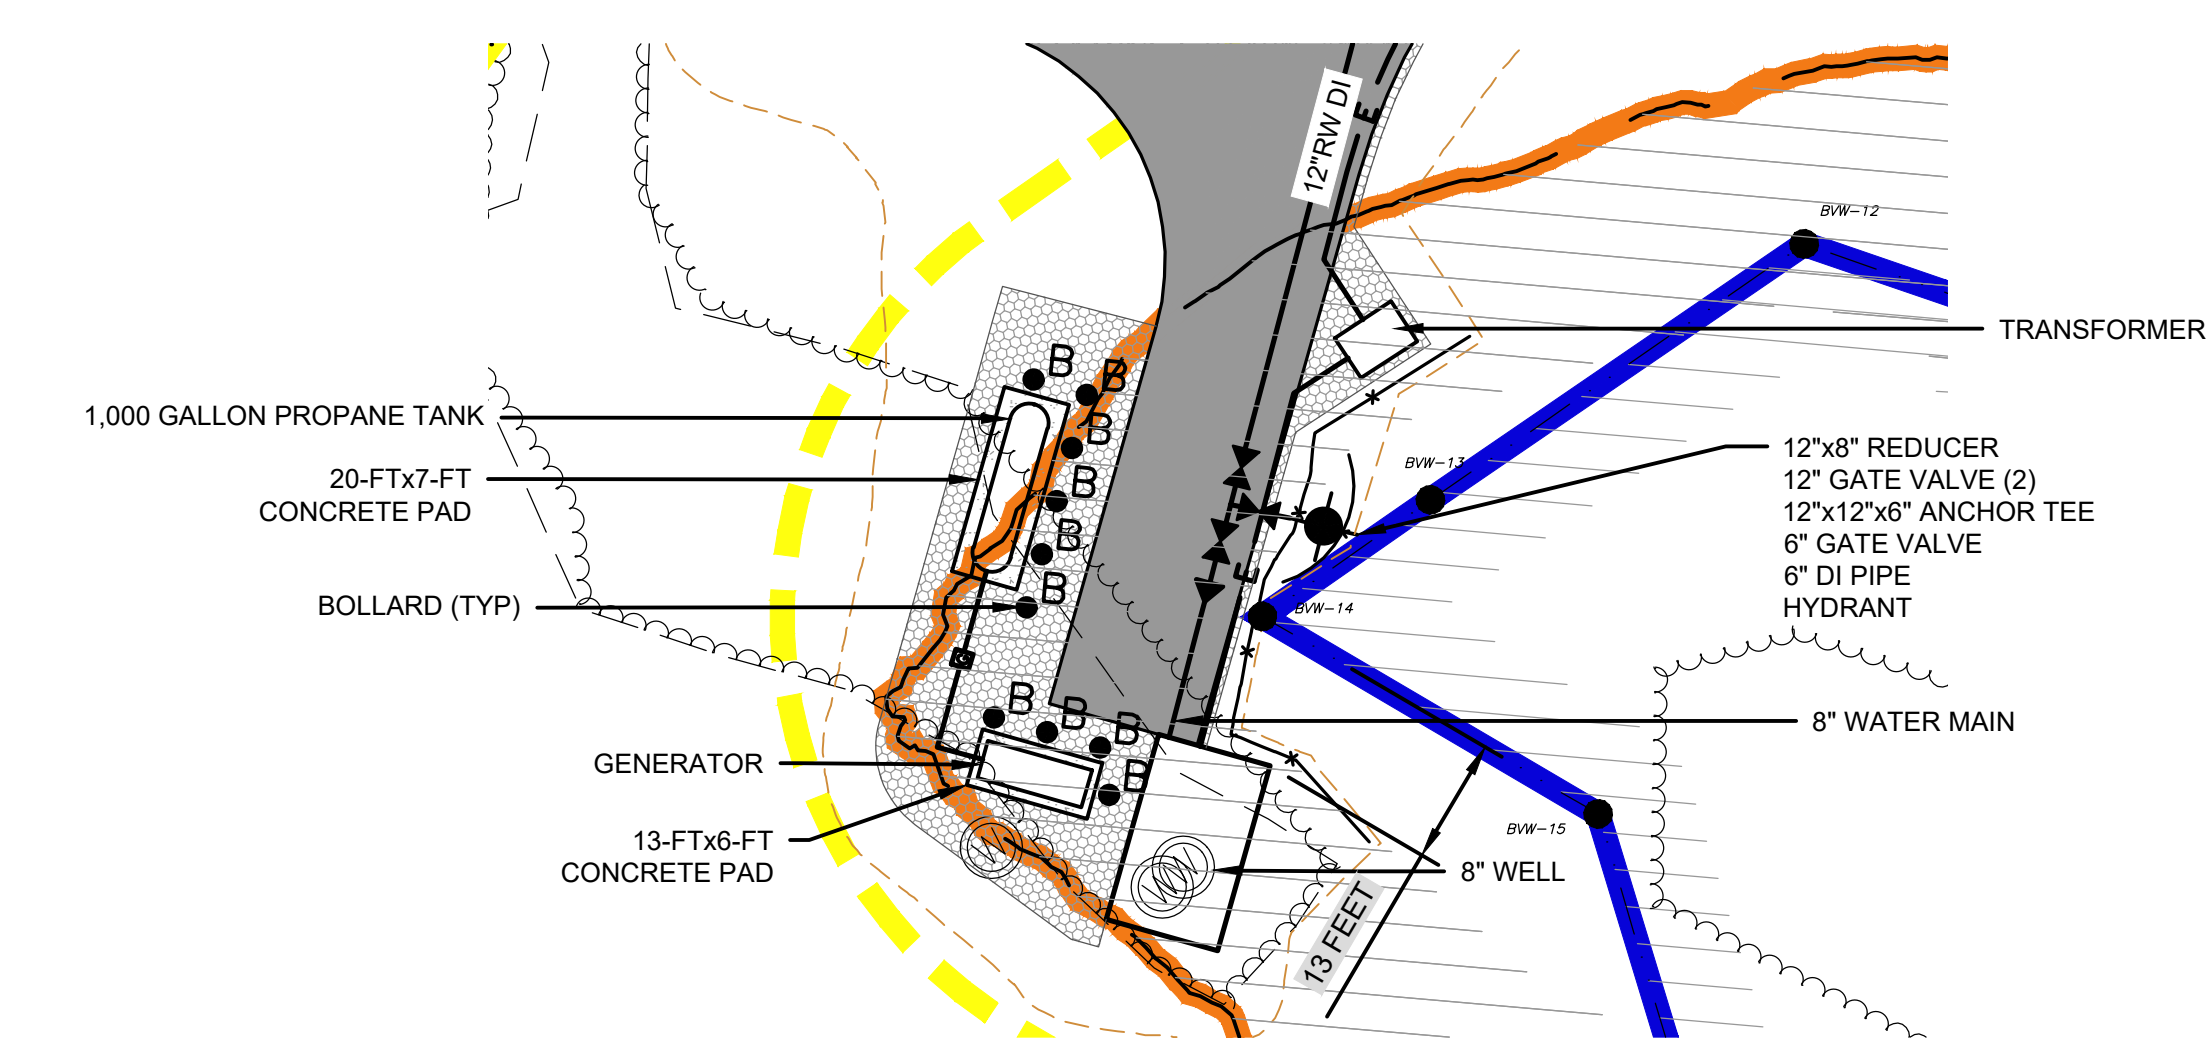

WELL SITE PLAN
SCALE: 1"=20'

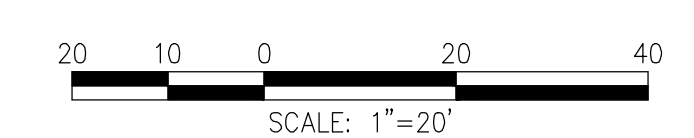

PLAN
SCALE: 1" = 80'



Project:
LITTLETON WATER DEPARTMENT
LITTLETON
LELWD
WATER & WASTE DEPARTMENT

TAYLOR STREET WELL AND
RAW WATER MAIN
TOWN CONTRACT NO. 1FB-2024
DWSRF NO. 12397
CONTRACT NO. 1

Weston & Sampson

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:

COMMONWEALTH OF MASSACHUSETTS
TARA E. MCMAHUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Tara E. McMahon

Issued For:

FOR PERMIT REVIEW ONLY

Scale:

AS NOTED

Date:

OCTOBER 2023

Drawn By:

GJK/RWS

Reviewed By:

SBR

Approved By:

TEM

W&S Project No.:

ENG23-0679

W&S File No.:


Drawing Title:

RAW WATER PLAN
CROSS COUNTRY



Sheet Number:

C103

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

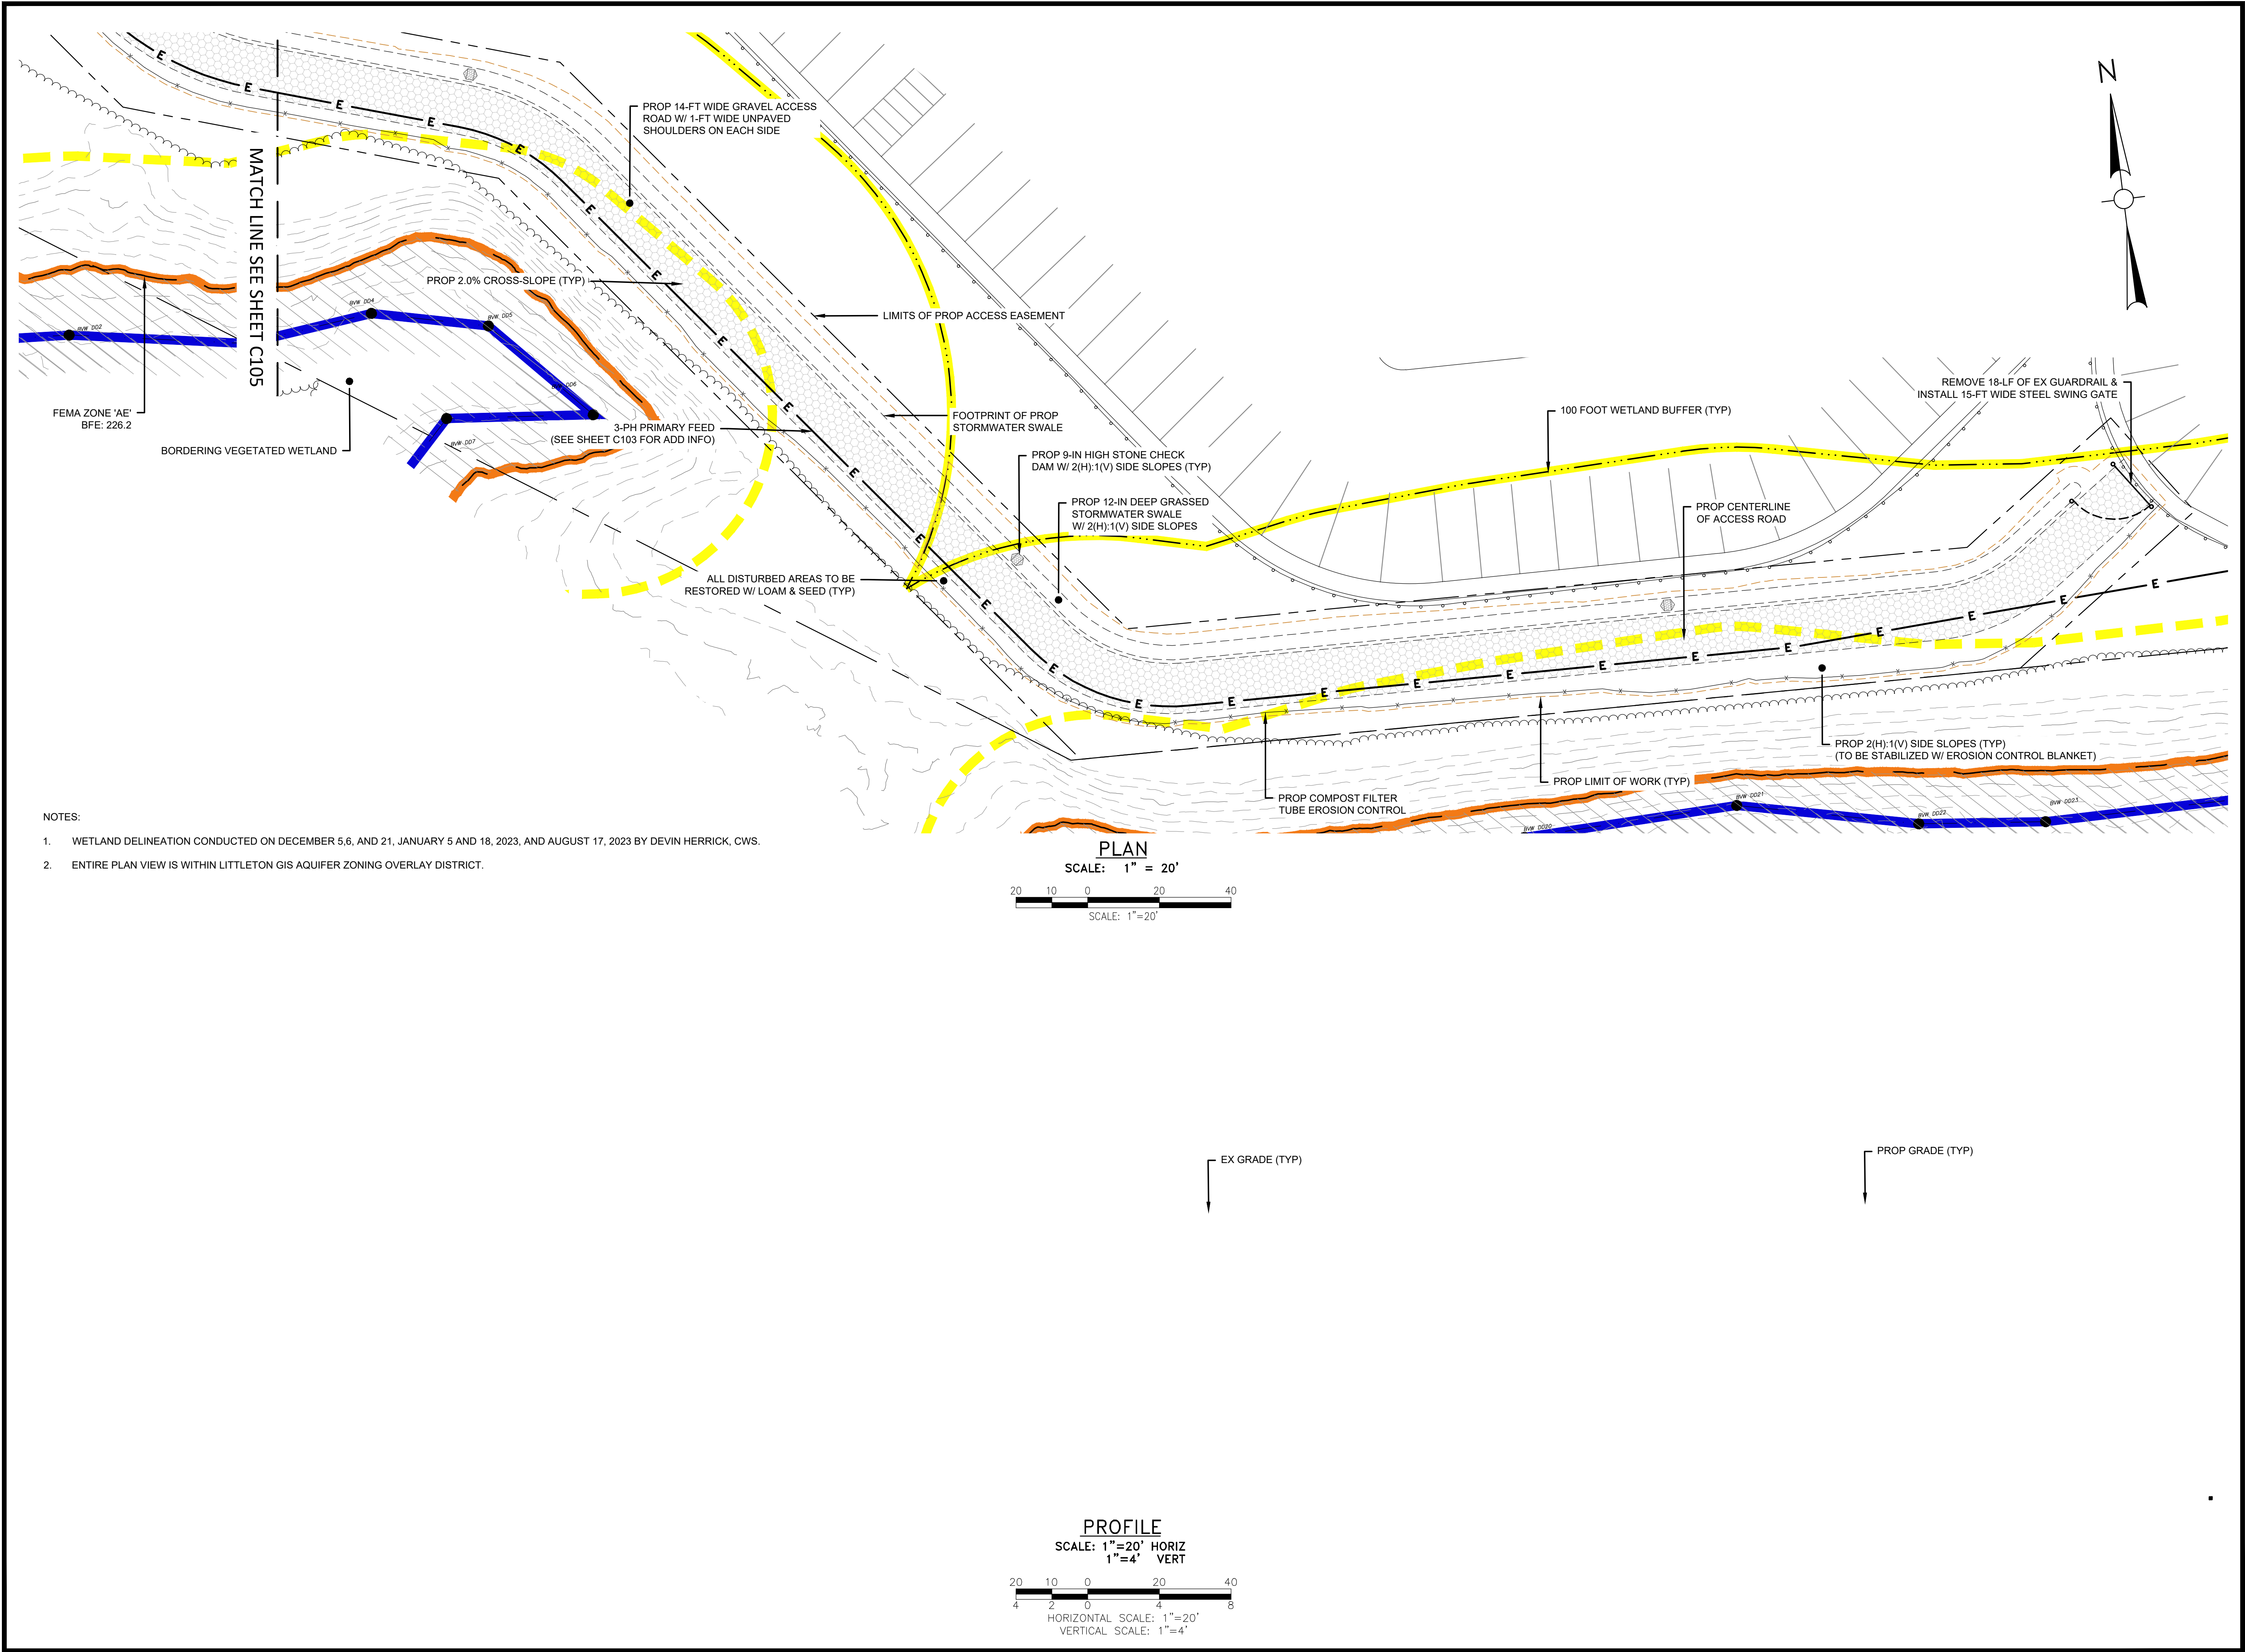

- NOTES:
1. WETLAND DELINEATION CONDUCTED ON DECEMBER 5,6, AND 21, JANUARY 5 AND 18, 2023, AND AUGUST 17, 2023 BY DEVIN HERRICK, CWS.
 2. ENTIRE PLAN VIEW IS WITHIN LITTLETON GIS AQUIFER ZONING OVERLAY DISTRICT.

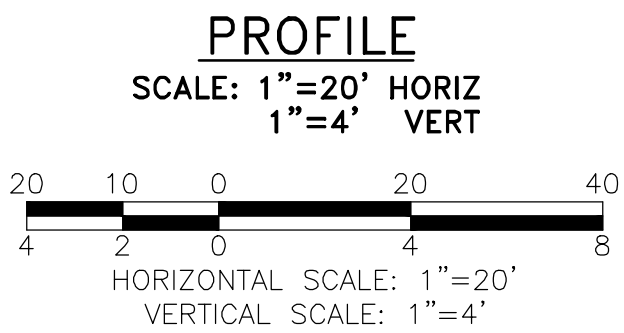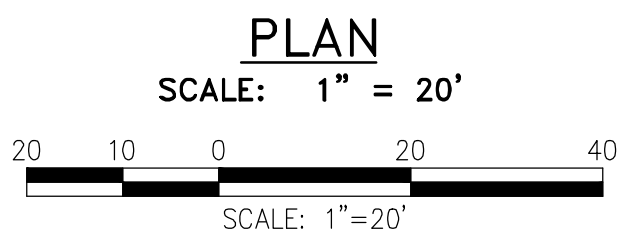

Project:
LITTLETON WATER DEPARTMENT
LITTLETON
LELWD
ELECTRIC, LIQUID & WATER DEPARTMENTS
TAYLOR STREET WELL AND RAW WATER MAIN
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO. 1

Weston & Sampson
Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:

Issued For:
FOR PERMIT REVIEW ONLY



Scale: AS NOTED

Date: OCTOBER 2023
Drawn By: GJK/RWS
Reviewed By: SBR
Approved By: TEM
W&S Project No.: ENG23-0679
W&S File No.:

Drawing Title:
ACCESS ROAD GRADING & DRAINAGE PLAN

Sheet Number:
C104

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

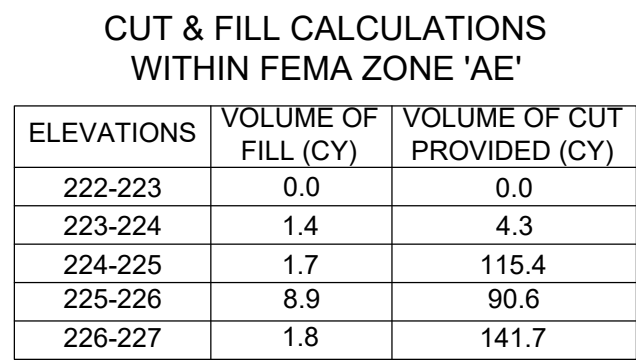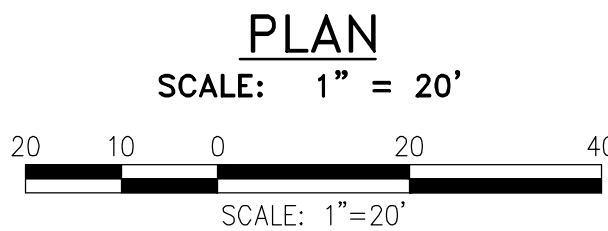

- NOTES:
1. WETLAND DELINEATION CONDUCTED ON DECEMBER 5,6, AND 21, JANUARY 5 AND 18, 2023, AND AUGUST 17, 2023 BY DEVIN HERRICK, CWS.
 2. ENTIRE PLAN VIEW IS WITHIN LITTLETON GIS AQUIFER ZONING OVERLAY DISTRICT.

Weston & SampsonSM
Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

[illegible]

COA:

Seal:



The seal is circular with a double-lined border. The outer ring contains the text "COMMONWEALTH OF MASSACHUSETTS" at the top and "PROFESSIONAL ENGINEER" at the bottom. The center of the seal contains the name "TARA E. MCMANUS", the number "No. 57127", and the word "REGISTERED". Below the seal is a handwritten signature that appears to read "Tara E. McManus".

Issued For:

FOR PERMIT
REVIEW ONLY

Scale:	AS NOTED
--------	----------

Date:	OCTOBER 2023
Drawn By:	GJK/RWS
Reviewed By:	SBR
Approved By:	TEM
W&S Project No.:	ENG23-0679
W&S File No.:	

Drawing Title:

ACCESS ROAD
GRADING &
DRAINAGE PLAN

Sheet Number:

C105

Weston & SampsonSM
Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

[illegible]

Seal:



Issued For:

FOR PERMIT
REVIEW ONLY

Scale: AS NOTED


Date:	OCTOBER 2023
Drawn By:	GJK
Reviewed By:	SBR
Approved By:	TEM
W&S Project No.:	ENG23-0679
W&S File No.:	


Drawing Title

BEAVER BROOK DIRECTIONAL DRILL


Sheet Number:

C201




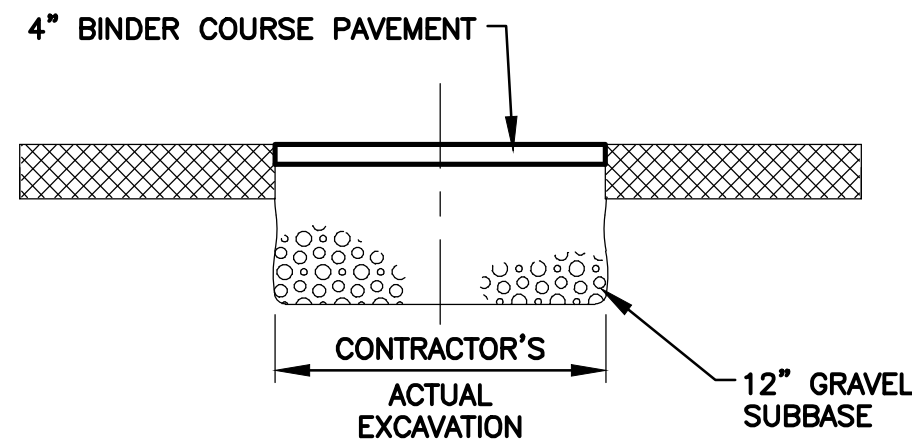

TEMPORARY TRENCH PAVEMENT
N.T.S.

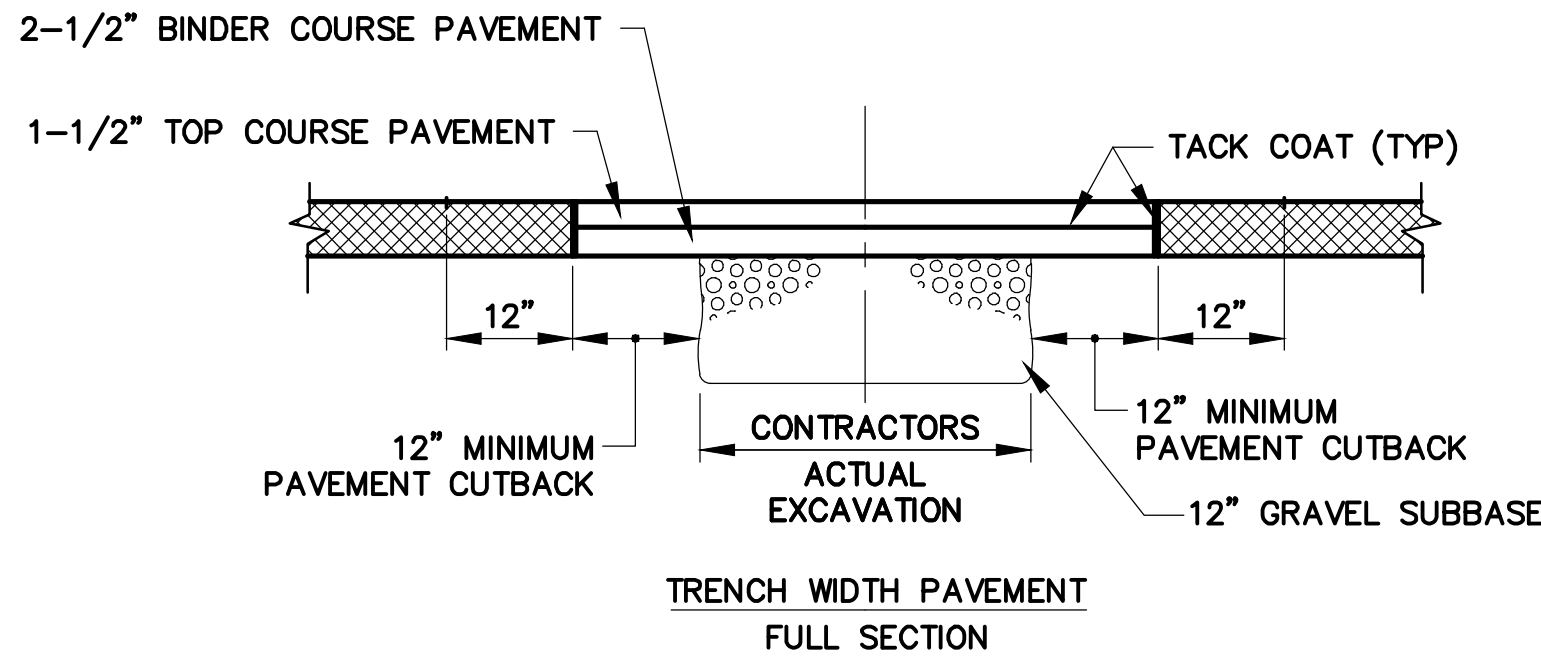

PERMANENT PAVEMENT REPLACEMENT DETAIL
N.T.S.

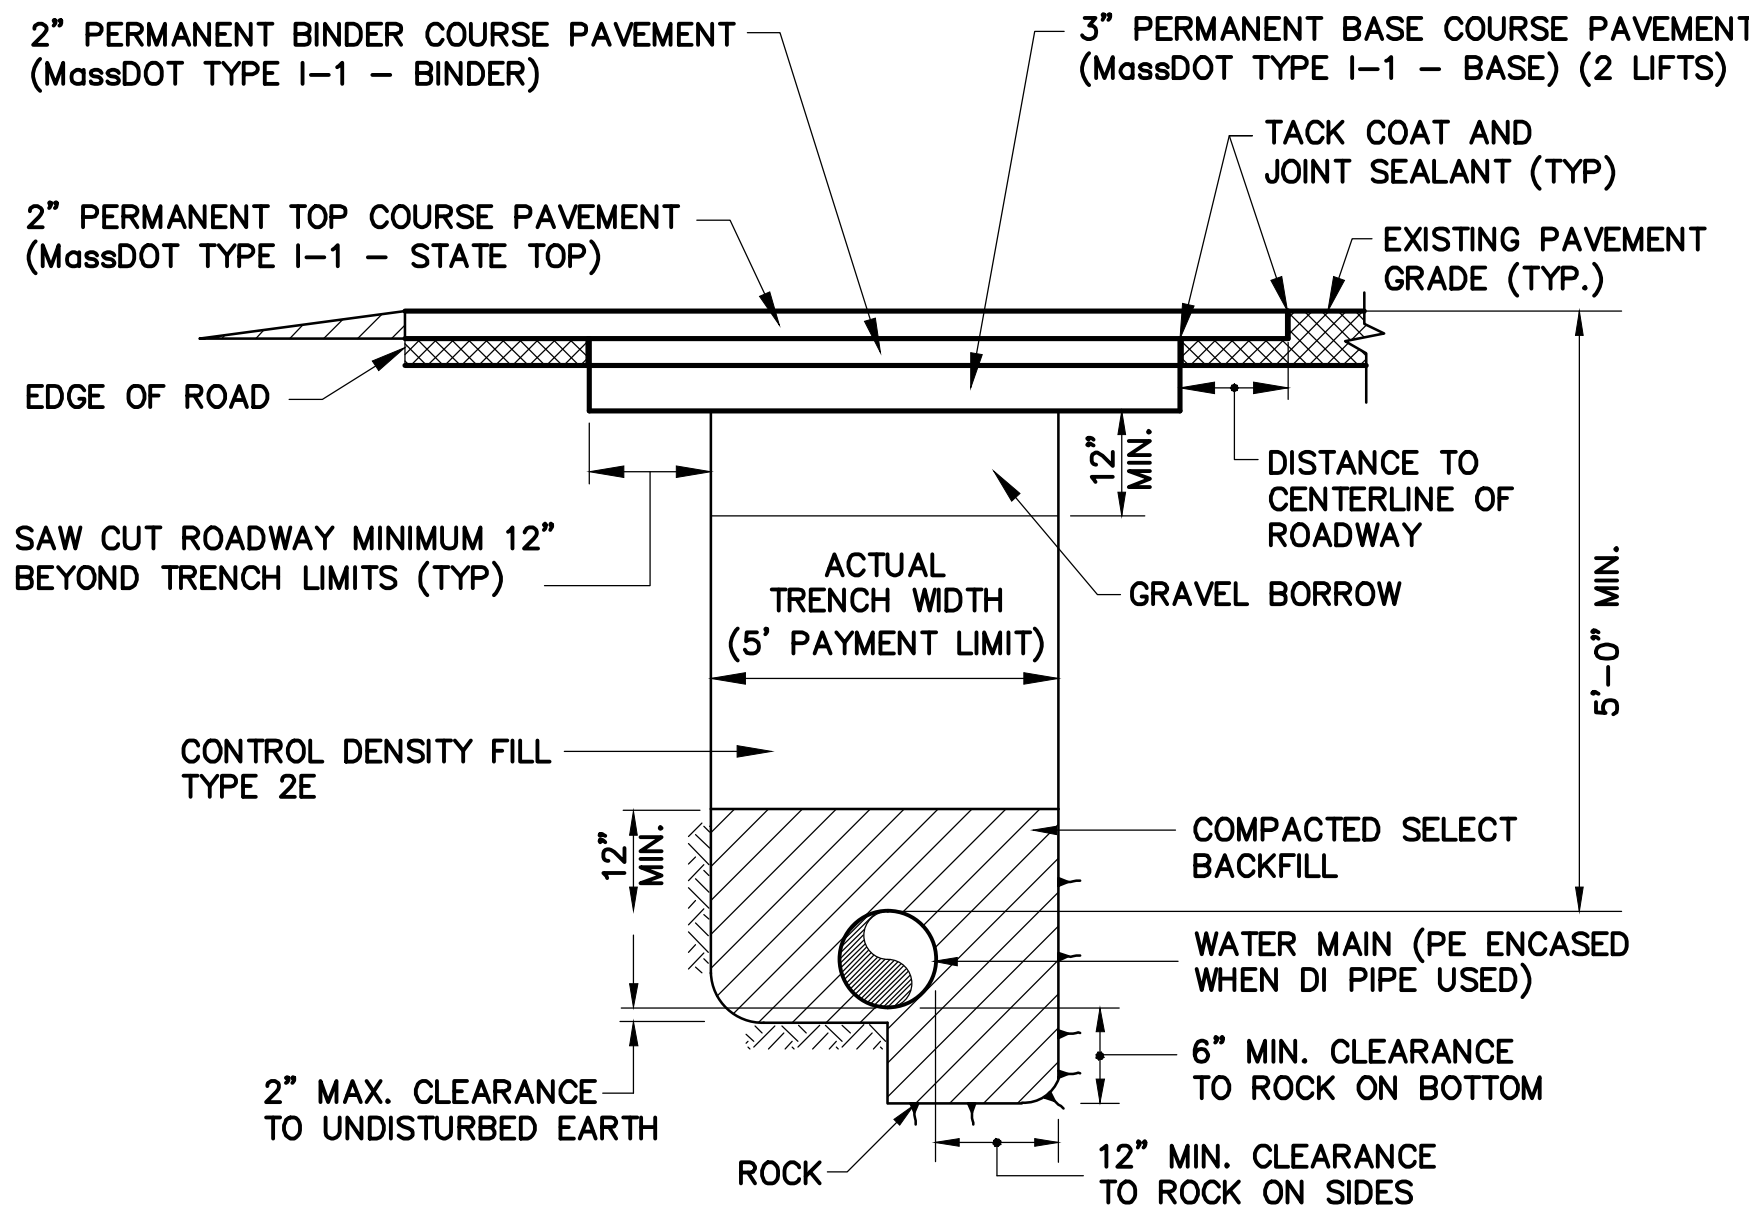


TYPE 3 AND TYPE 4
MASSACHUSETTS DEPARTMENT OF TRANSPORTATION (MassDOT)
PERMANENT TRENCH PAVEMENT AND WATER MAIN TRENCH
N.T.S.


NOTES:

- SEE SECTION 32 11 00, PAVING FOR PAVEMENT SCHEDULE.
- FOR ALL TRENCH PAVEMENTS, CONTRACTOR SHALL INSTALL ASPHALT EMULSION TACK COAT TO ALL SUBSURFACES AND VERTICAL SAW CUTS PRIOR TO INSTALLATION OF PERMANENT PAVEMENT.
- PAVEMENT SHALL BE INSTALLED FLUSH WITH EXISTING GRADE BEFORE WINTER SHUTDOWN.
- TOP LAYER OF PAVEMENT SHALL BE INSTALLED BY MECHANICAL MEANS.


PAVEMENT REPLACEMENT DETAILS
N.T.S.

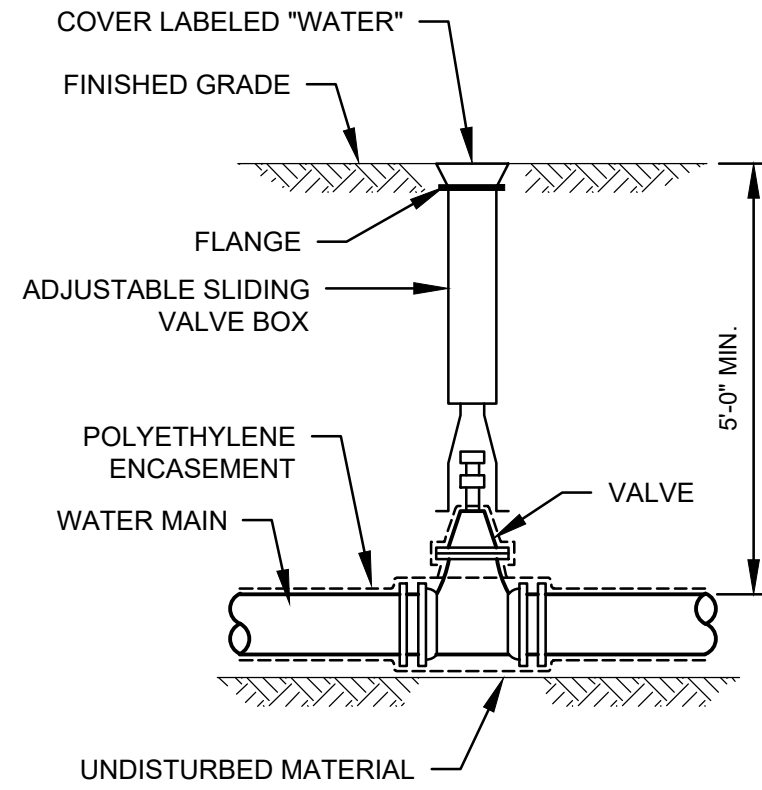

VALVE AND BOX DETAIL
N.T.S.

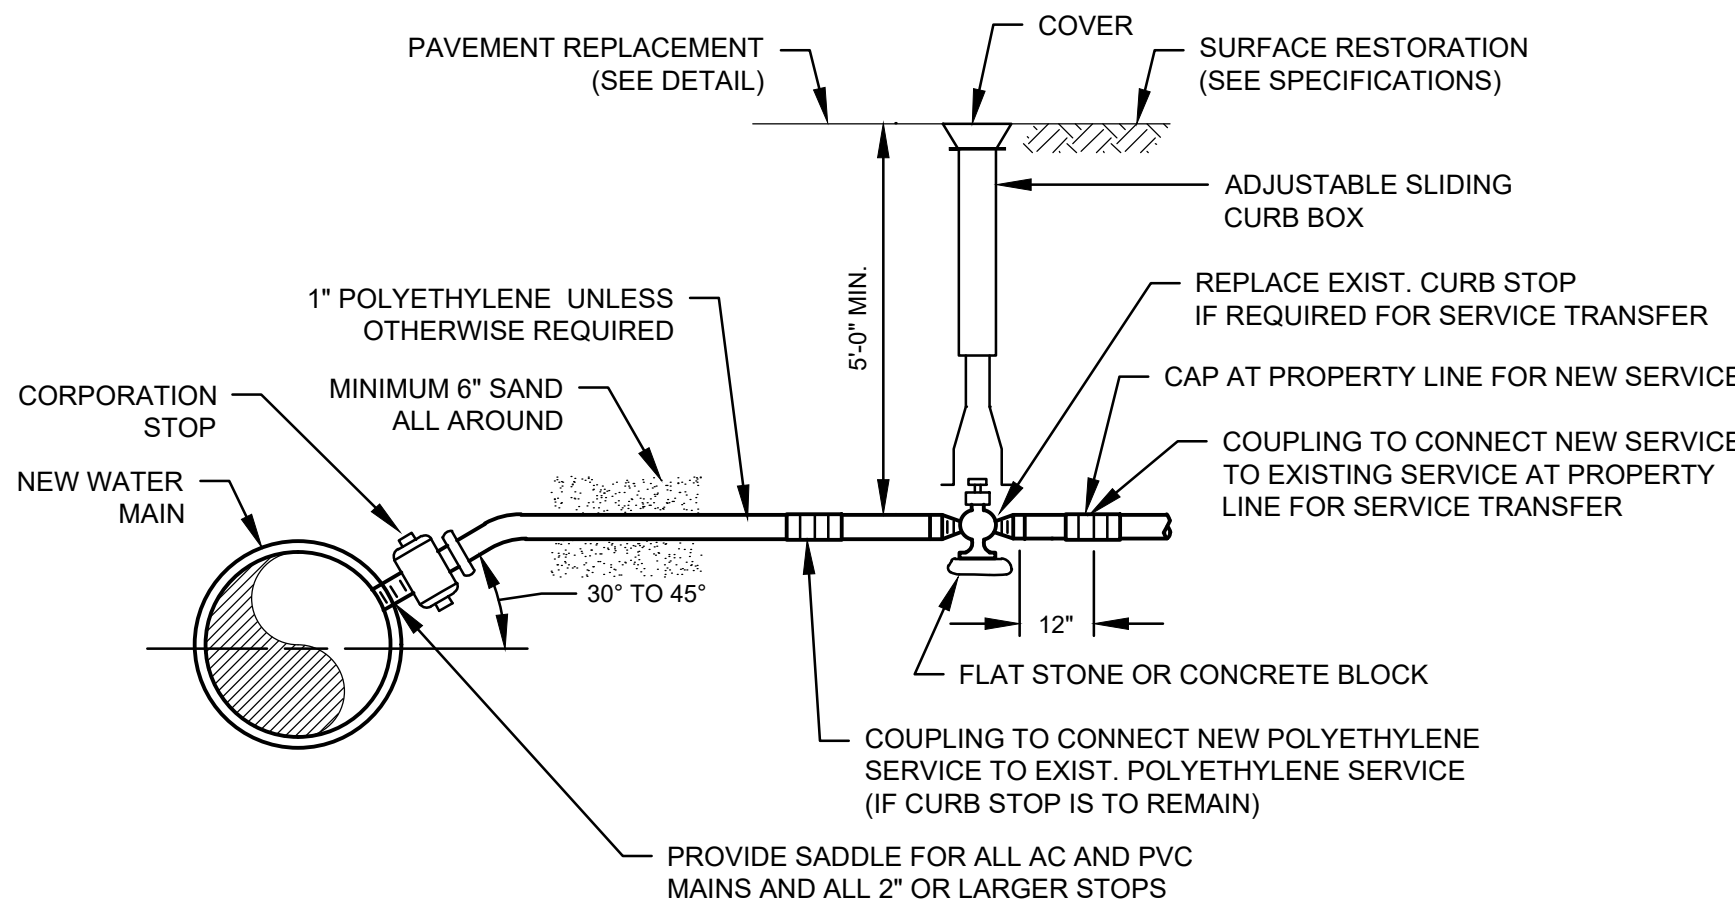

WATER SERVICE DETAIL
N.T.S.

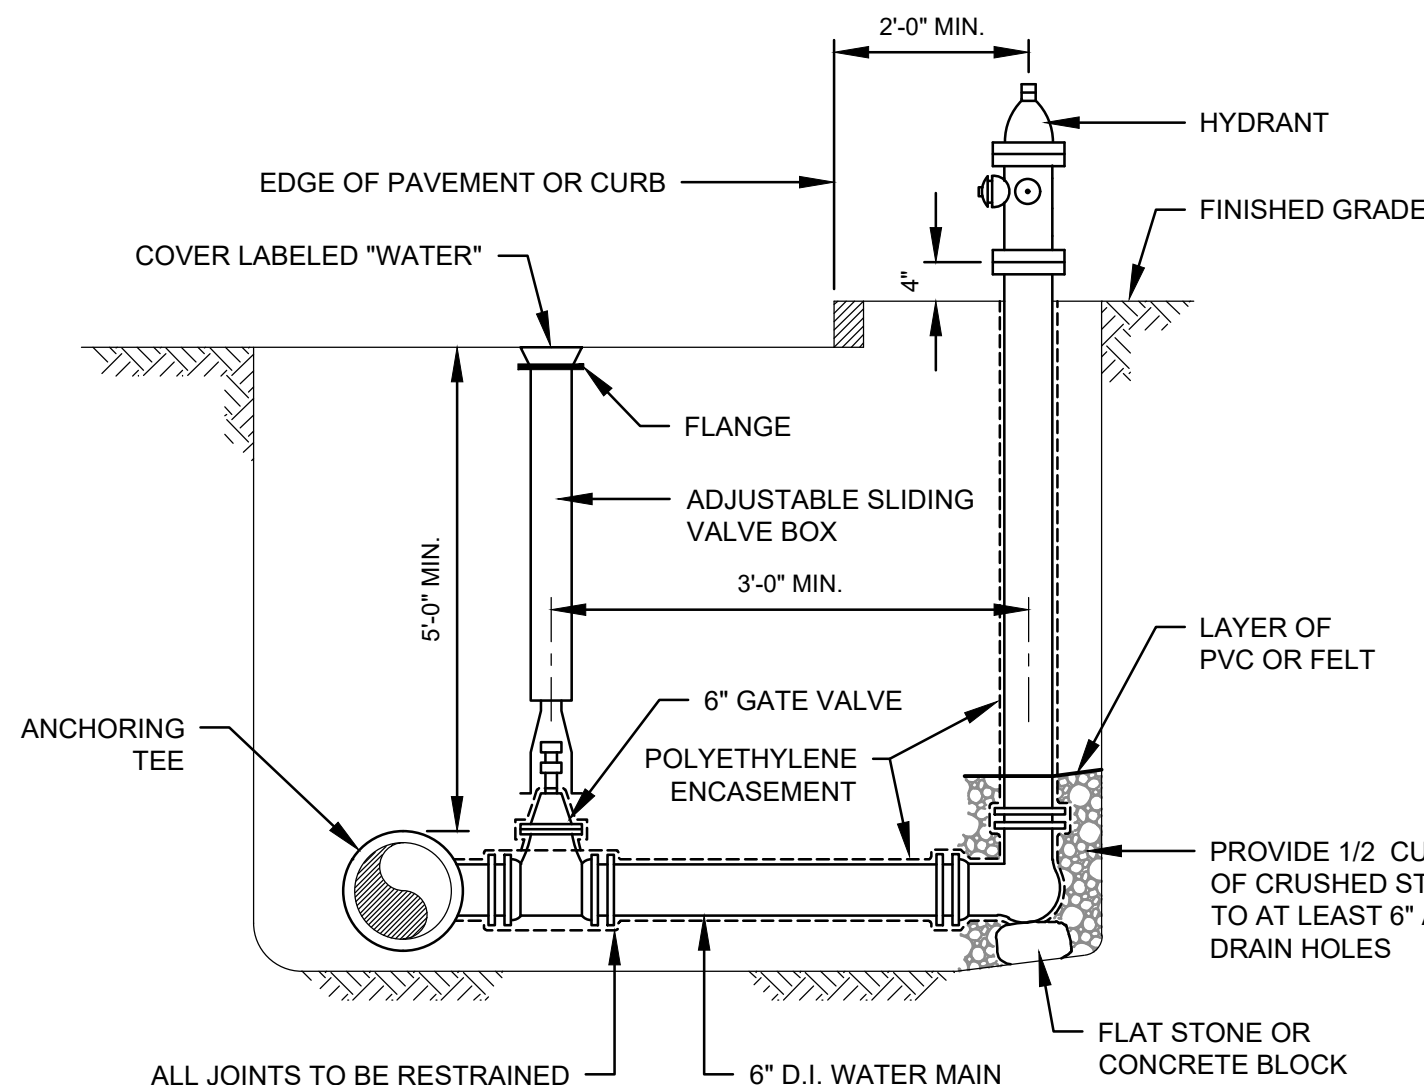

NOTE:
USE TWO 6" BENDS OR OFFSET ON LATERAL TO ACHIEVE
REQUIRED HYDRANT ELEVATION IF NECESSARY.

HYDRANT AND VALVE DETAIL
N.T.S.


REQUIRED LENGTH OF RESTRAINED JOINTS FROM FITTINGS (FEET)

PIPE SIZE	90° BEND	45° BEND OR WYE BRANCH	22 1/2° BEND	11 1/4° BEND	PLUG, CAP OR IN-LINE VALVE	TEE (BRANCH)
6"	25 (30.5)	10.5 (12.5)	5 (6)	2.5 (3)	43 (64)	34 (51)
8"	33 (40)	13.5 (16.5)	6.5 (8)	3 (4)	55 (82)	47 (70)
10"	40 (48.5)	16.5 (20)	8 (9.5)	4 (5)	67 (100)	58 (87)
12"	47 (56.5)	19.5 (23.5)	9.5 (11.5)	4.5 (5.5)	79 (118)	70 (105)
16"	59.5 (72)	24.5 (30)	12 (14.5)	6 (7)	101 (152)	92 (139)
20"	72 (86.5)	30 (36)	14.5 (17)	7 (8.5)	123 (184)	114 (171)
24"	84 (100)	35 (41)	16.5 (20)	8 (10)	144 (216)	134 (202)
30"	100 (120)	41 (50)	20 (24)	10 (12)	174 (261)	165 (247)

NOTES:


- RESTRAINED LENGTHS LISTED IN PARENTHESES ARE FOR PIPE WRAPPED IN POLYETHYLENE. THE OTHER ASSOCIATED LENGTHS ARE FOR PLAIN UNWRAPPED DUCTILE IRON PIPE.
- THE CONTRACTOR SHALL USE THIS TABLE IN CONJUNCTION WITH THE APPROPRIATE PIPE SPECIFICATION SECTION.

RESTRAINED JOINT TABLE


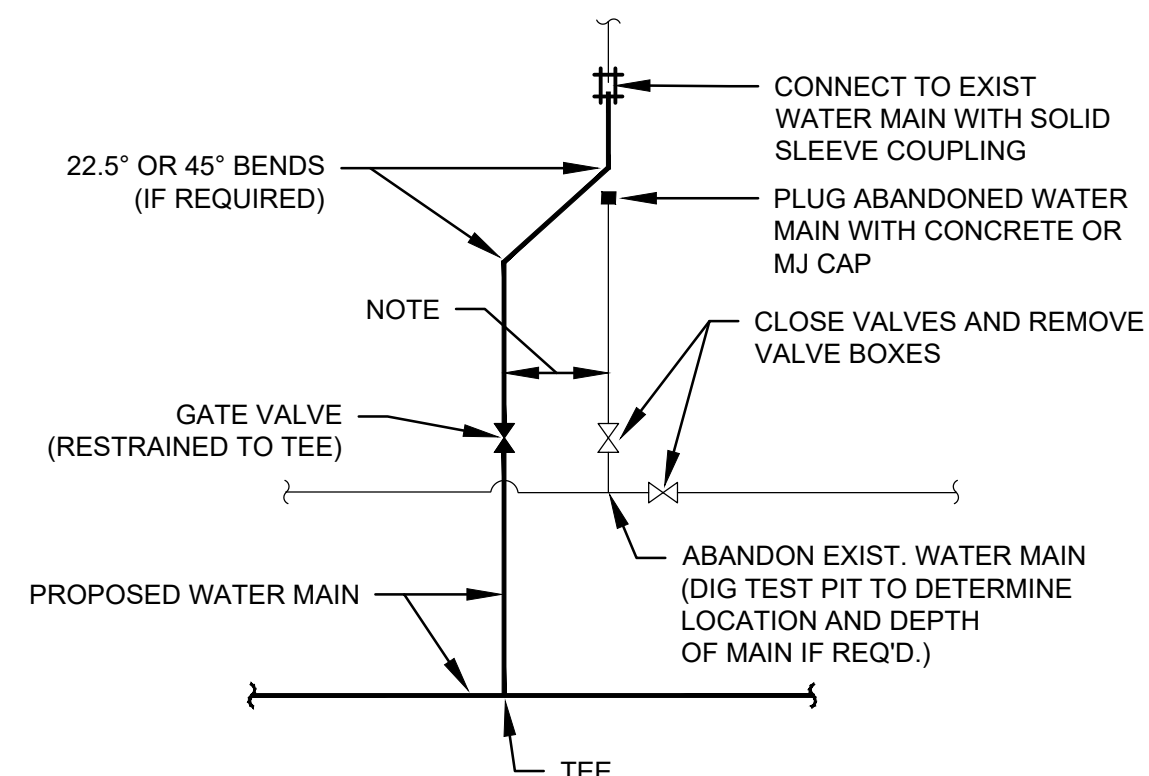


NOTE:
MINIMUM PRACTICAL DISTANCE - GENERALLY NO MORE THAN 2 FT.

WATER MAIN LATERAL CONNECTION
N.T.S.

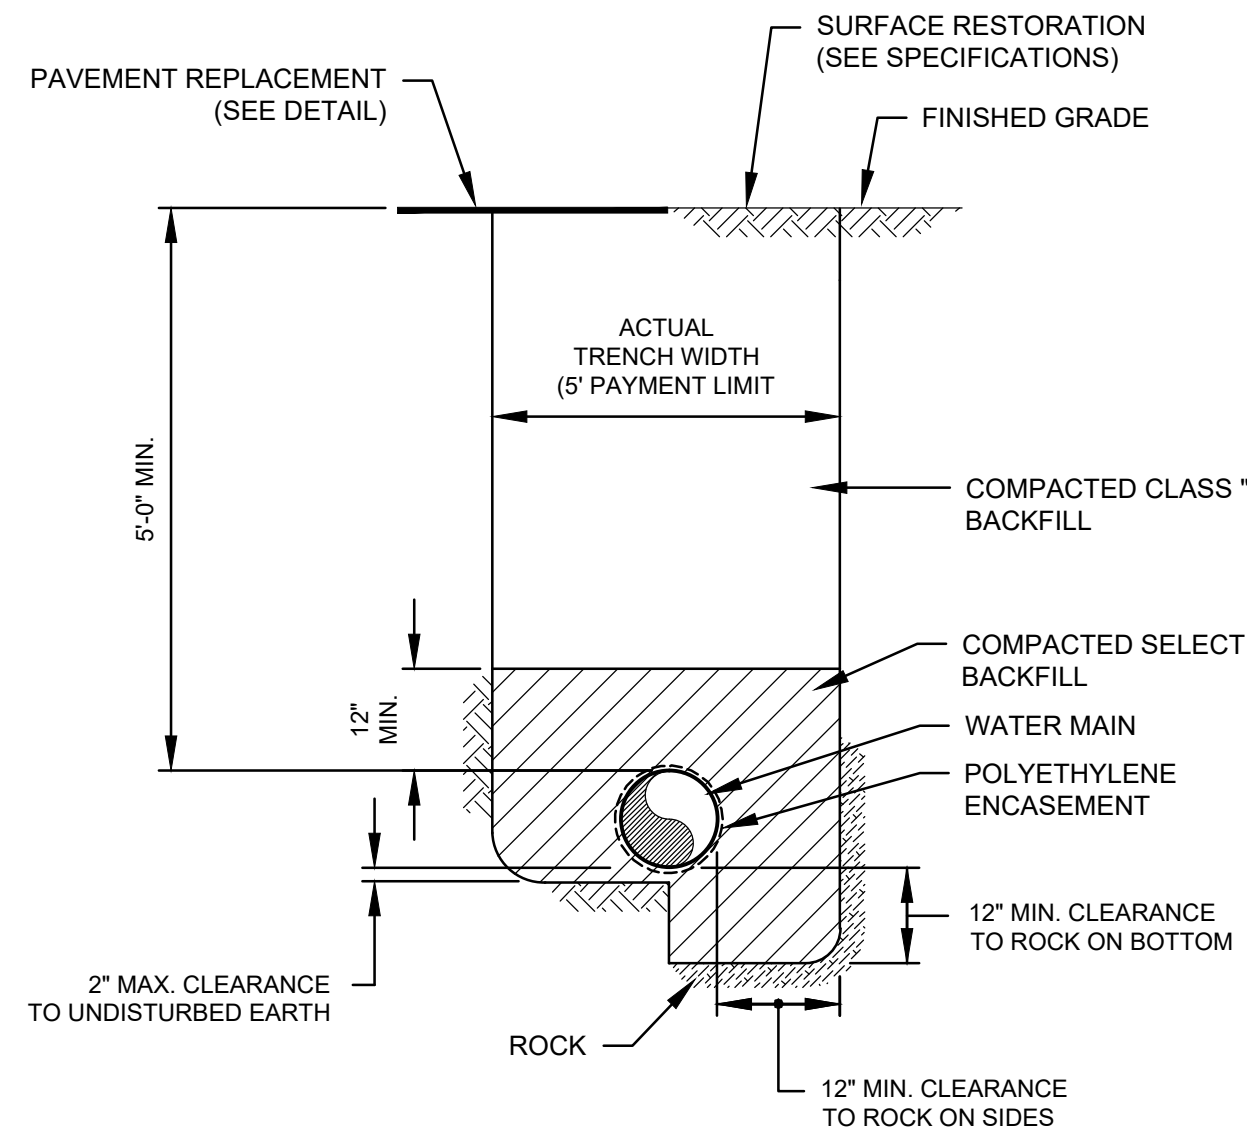


WATER MAIN TRENCH DETAIL
N.T.S.

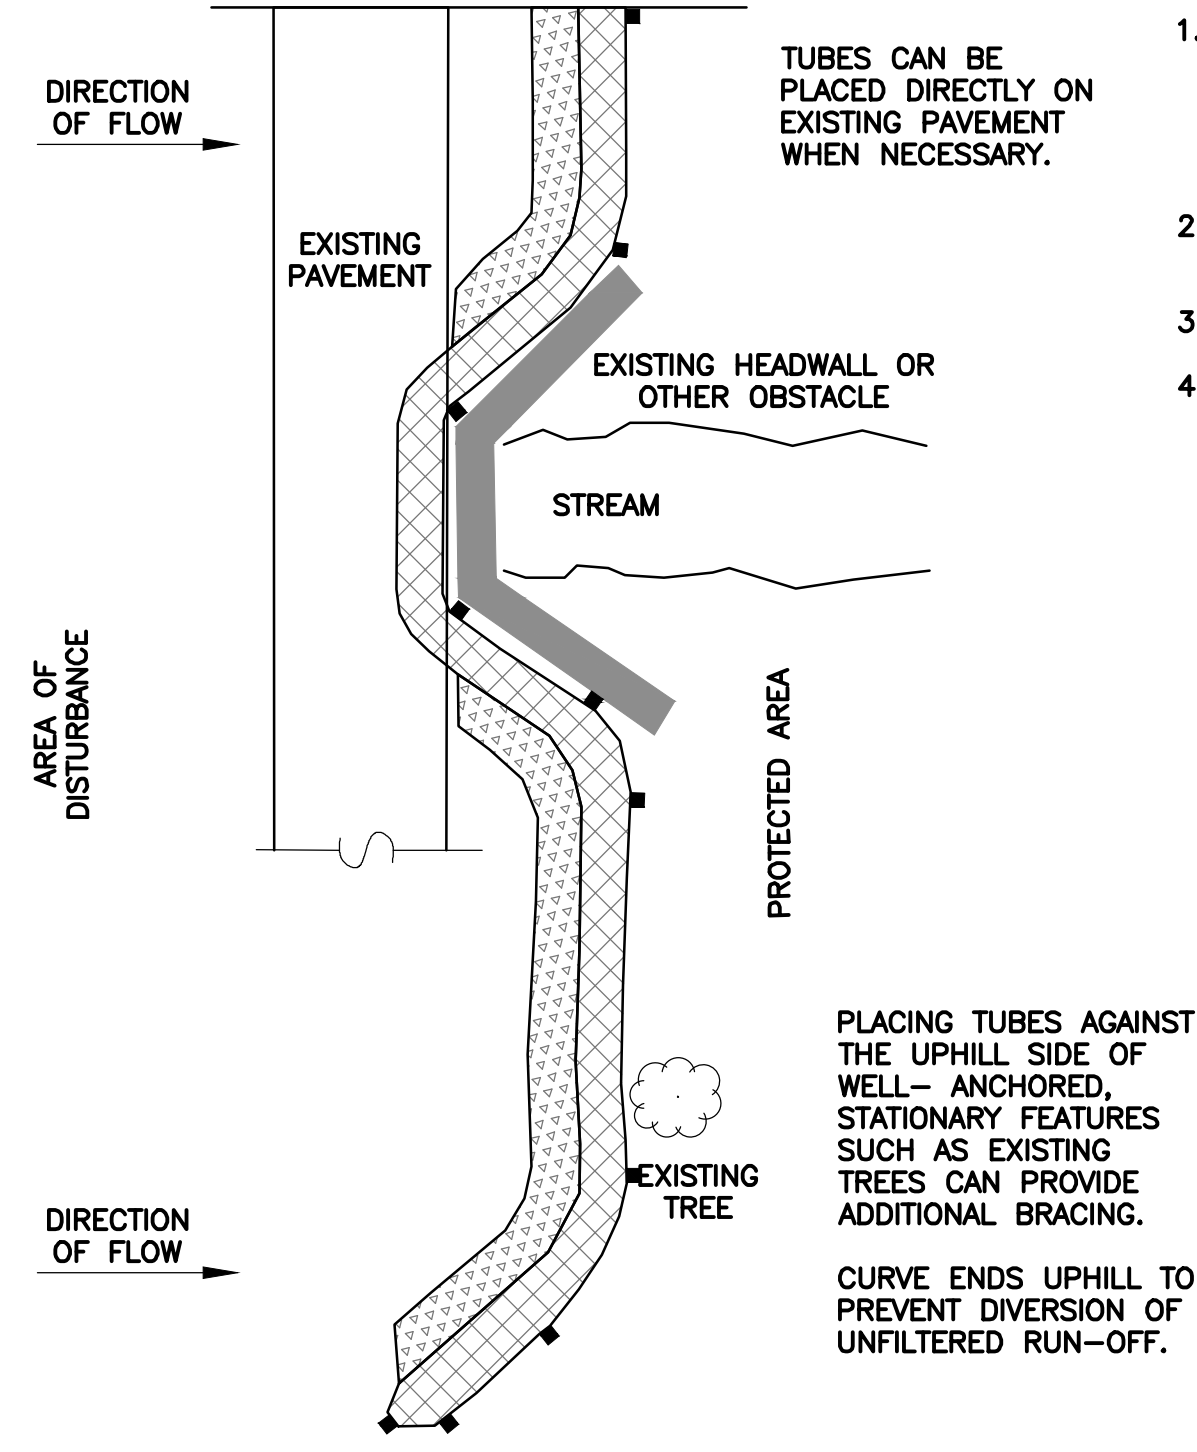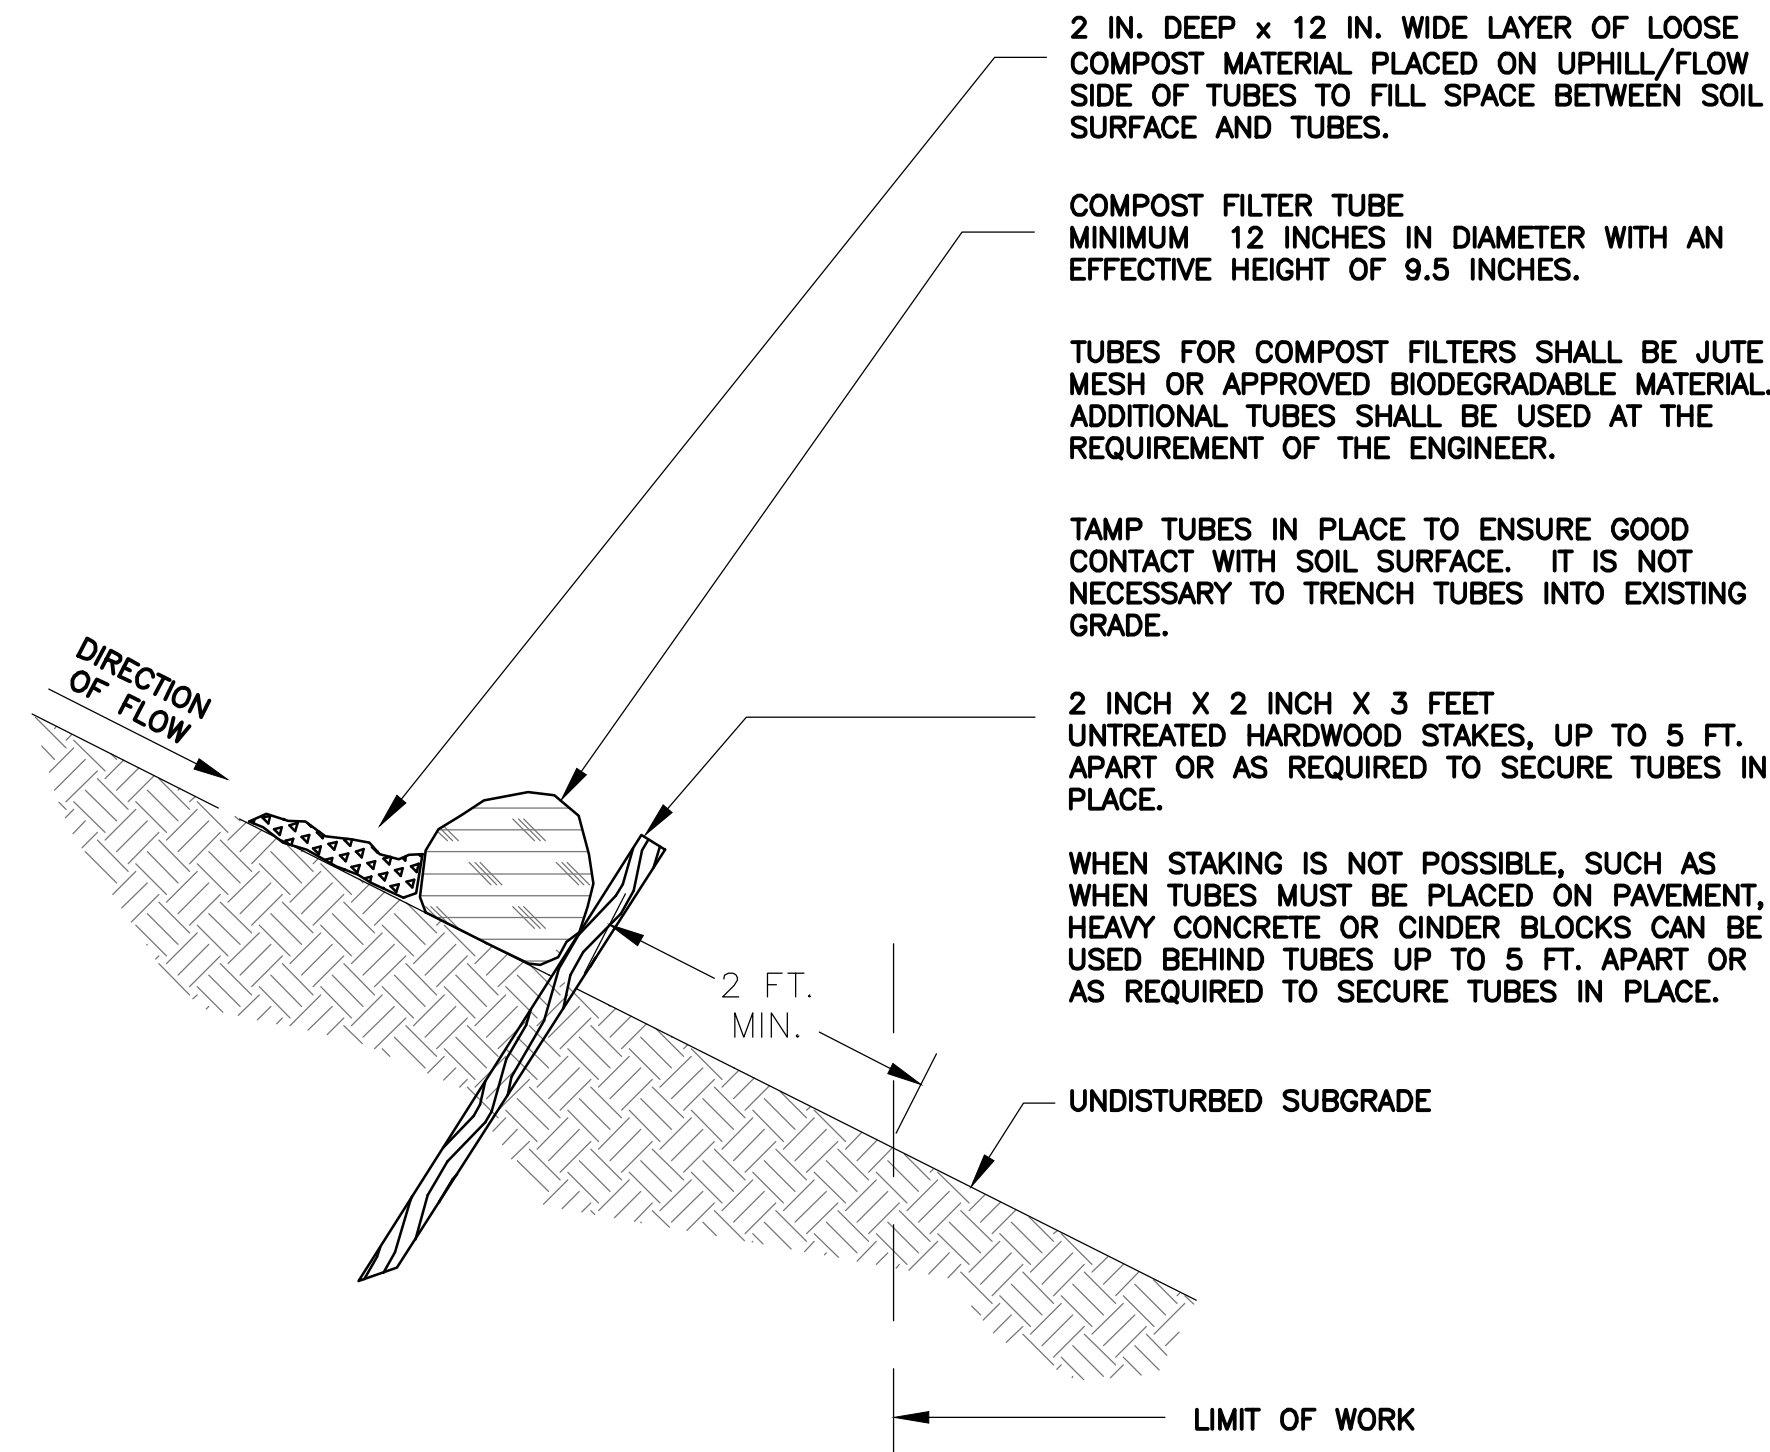


PLAN VIEW
SINGLE COMPOST FILTER TUBE DETAIL
NOT TO SCALE

GENERAL NOTES:



1. PROVIDE A MINIMUM TUBE DIAMETER OF 12 INCHES FOR SLOPES UP TO 50 FEET IN LENGTH WITH A SLOPE RATIO OF 3H:1V OR STEEPER. LONGER SLOPES OF 3H:1V MAY REQUIRE LARGER TUBE DIAMETER OR ADDITIONAL COURSING OF FILTER TUBES TO CREATE A FILTER BERM. REFER TO MANUFACTURER'S RECOMMENDATIONS FOR SITUATIONS WITH LONGER OR STEEPER SLOPES.
2. INSTALL TUBES ALONG CONTOURS AND PERPENDICULAR TO SHEET OR CONCENTRATED FLOW.
3. DO NOT INSTALL IN PERENNIAL, EPHEMERAL OR INTERMITTENT STREAMS.
4. CONFIGURE TUBES AROUND EXISTING SITE FEATURES TO MINIMIZE SITE DISTURBANCE AND MAXIMIZE CAPTURE AREA OF STORMWATER RUN-OFF.

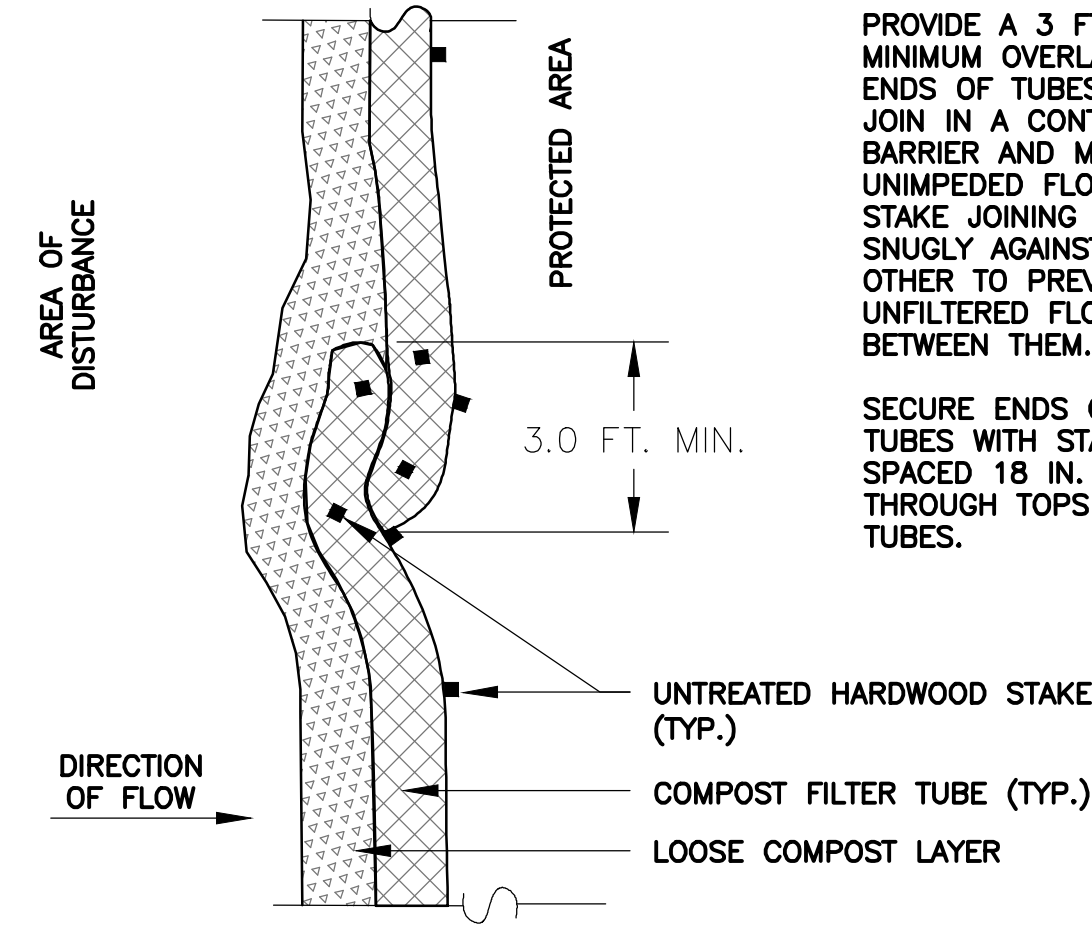


PLAN VIEW - JOIN DETAIL

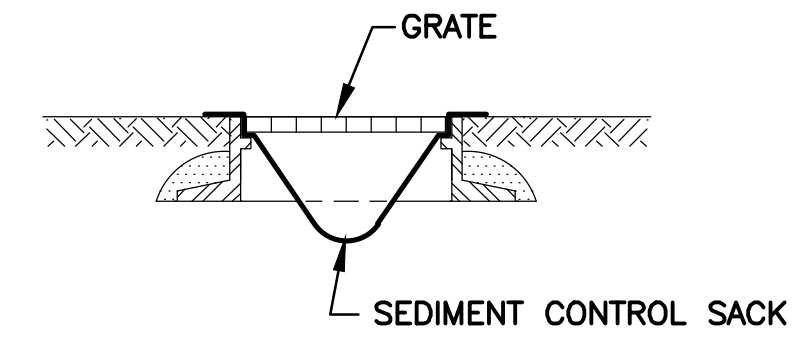


CATCH BASIN PROTECTION DETAIL
N.T.S.

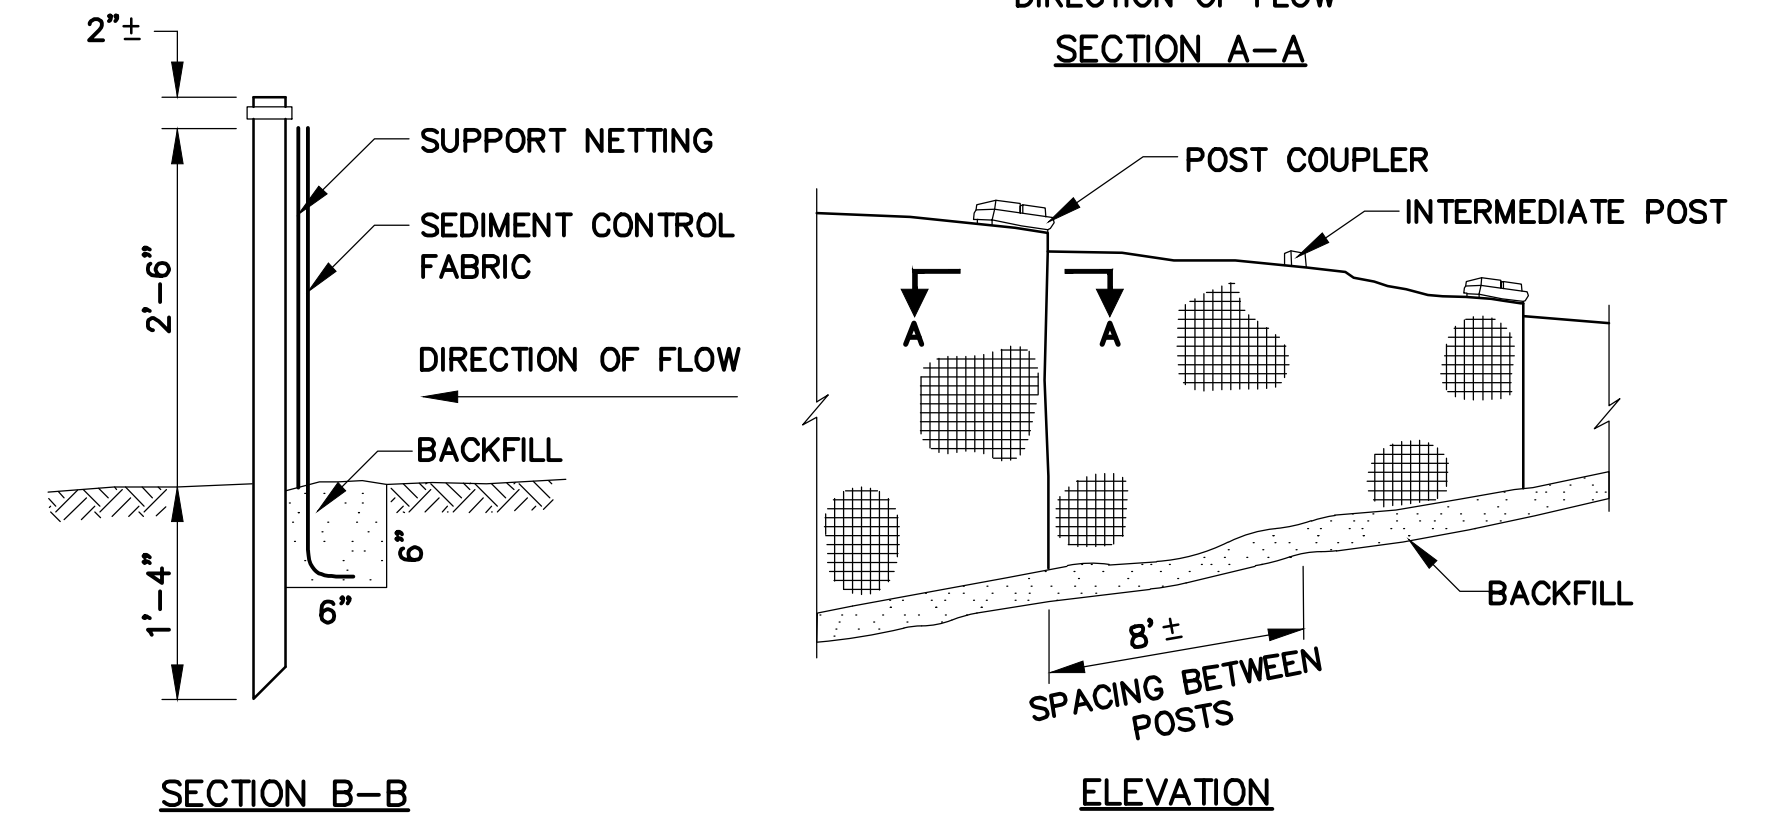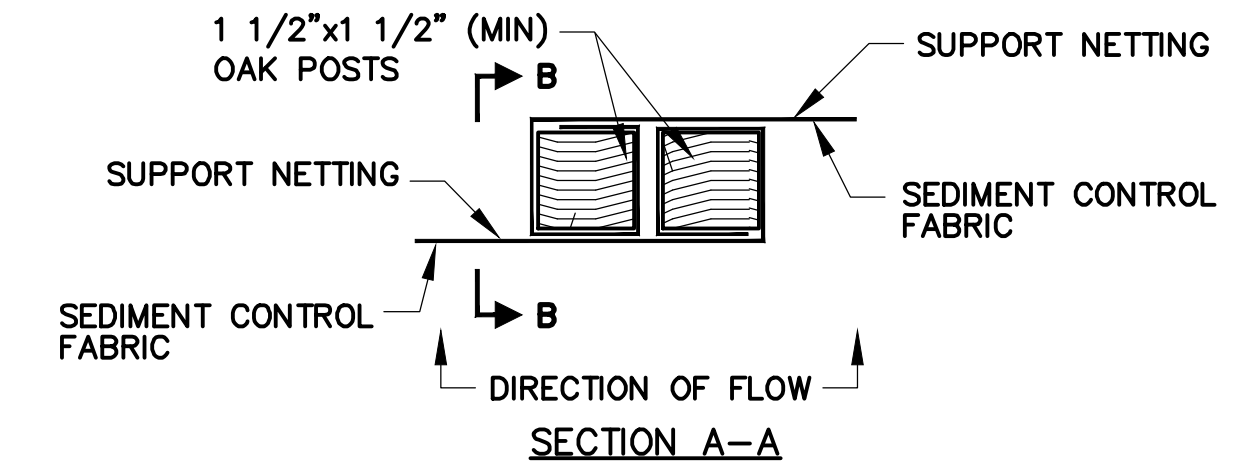


SILT FENCE DETAIL
N.T.S.

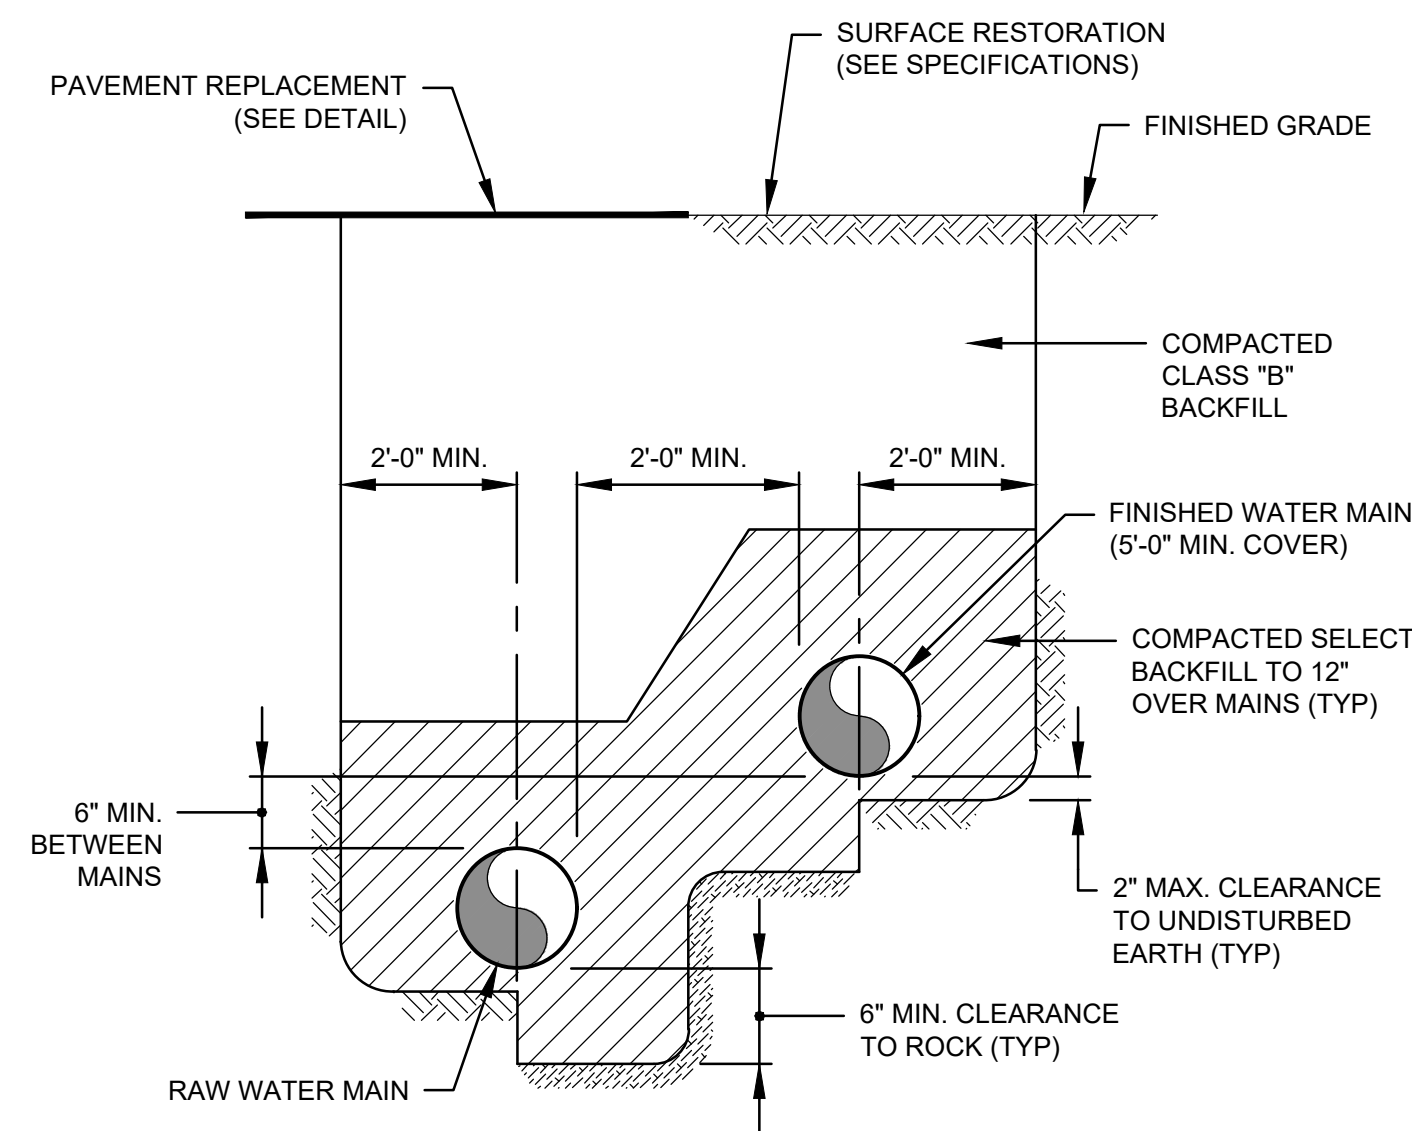

DUAL WATER MAIN TRENCH DETAIL
N.T.S.

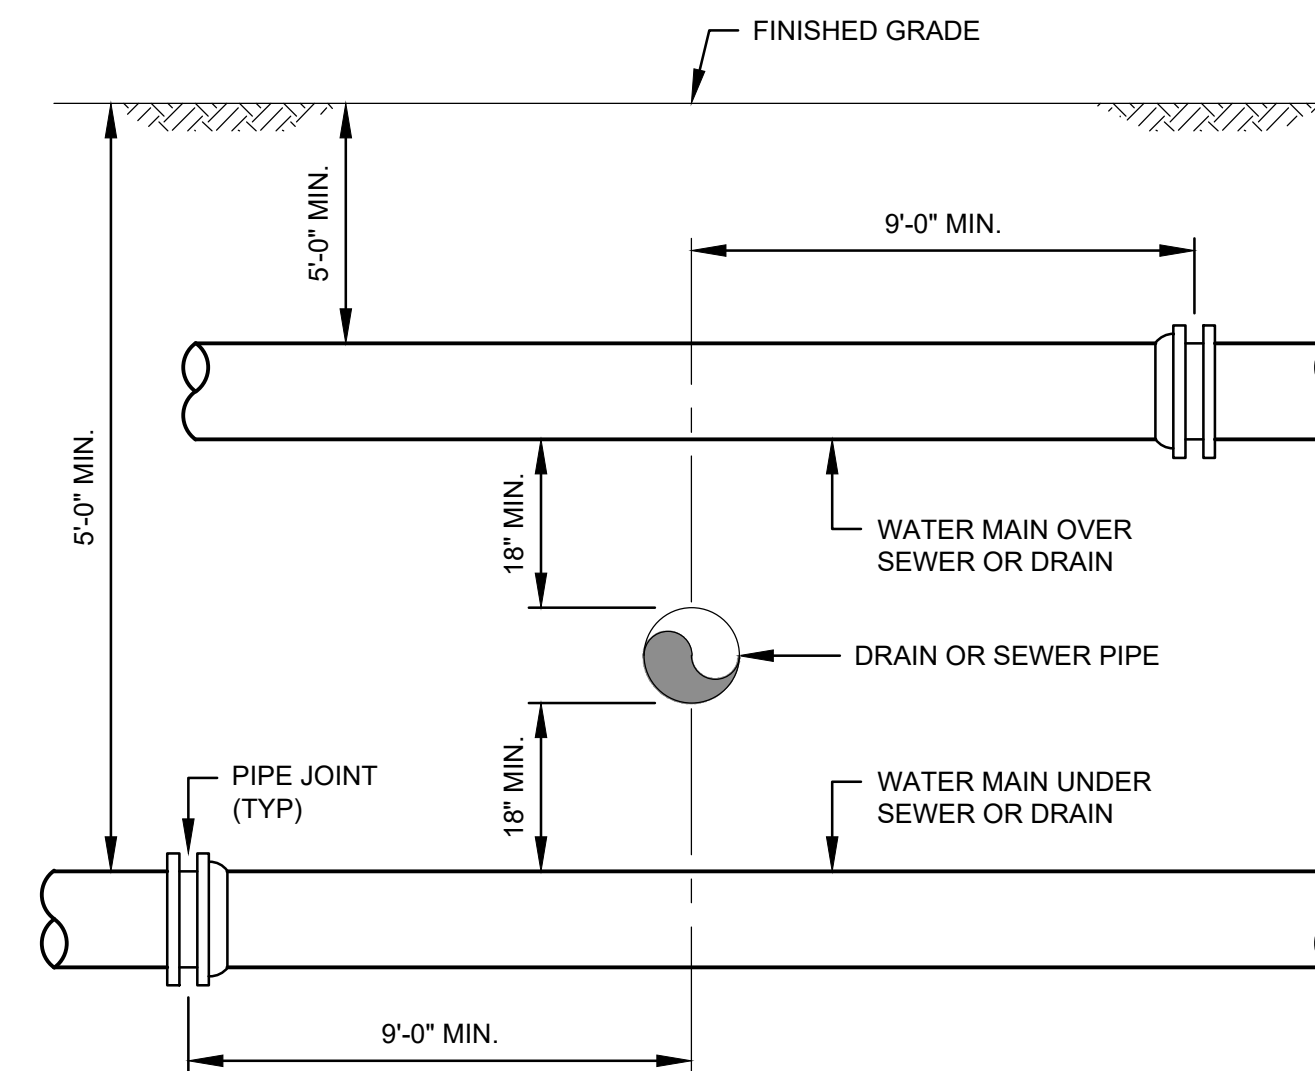

SEWER OR DRAIN CROSSING DETAIL
N.T.S.

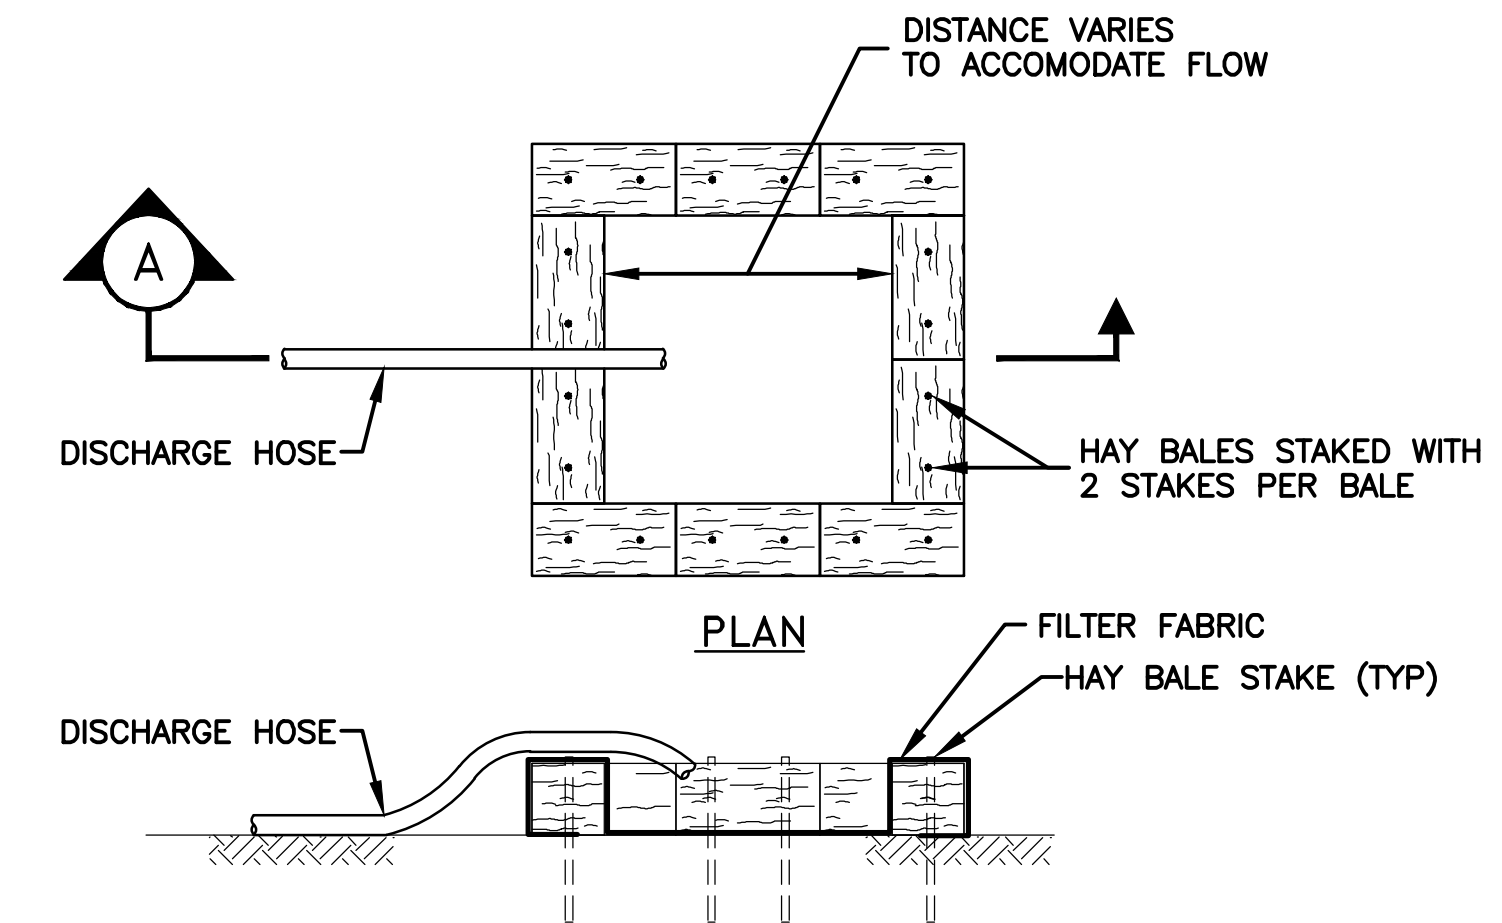

SECTION A

DEWATERING DISCHARGE DISPOSAL DETAIL
N.T.S.

Revisions:		
No.	Date	Description

COA:



Issued For:
FOR PERMIT REVIEW ONLY

Scale: AS NOTED

Date: OCTOBER 2023
Drawn By: GJK/RWS
Reviewed By: SBR
Approved By: TEM
W&S Project No.: ENG23-0679
W&S File No.:

Drawing Title:

DETAILS II

Sheet Number:

C502

[illegible]

COA:

Seal:



The seal is circular with a serrated outer edge. The text "COMMONWEALTH OF MASSACHUSETTS" is written along the top inner border. In the center, the name "TARA E MCMANUS" is printed above the number "No. 57127". Below the number, the word "REGISTERED" is written in a curved path, and "PROFESSIONAL ENGINEER" is written along the bottom inner border.

Issued For:

FOR PERMIT
REVIEW ONLY

Scale: AS NOTED

100

Date:	OCTOBER 2023
Drawn By:	GJK/RWS
Reviewed By:	SBR
Approved By:	TEM
W&S Project No.:	ENG23-0679
W&S File No.:	


Drawing Title:

DETAILS III

Sheet Number:


C503



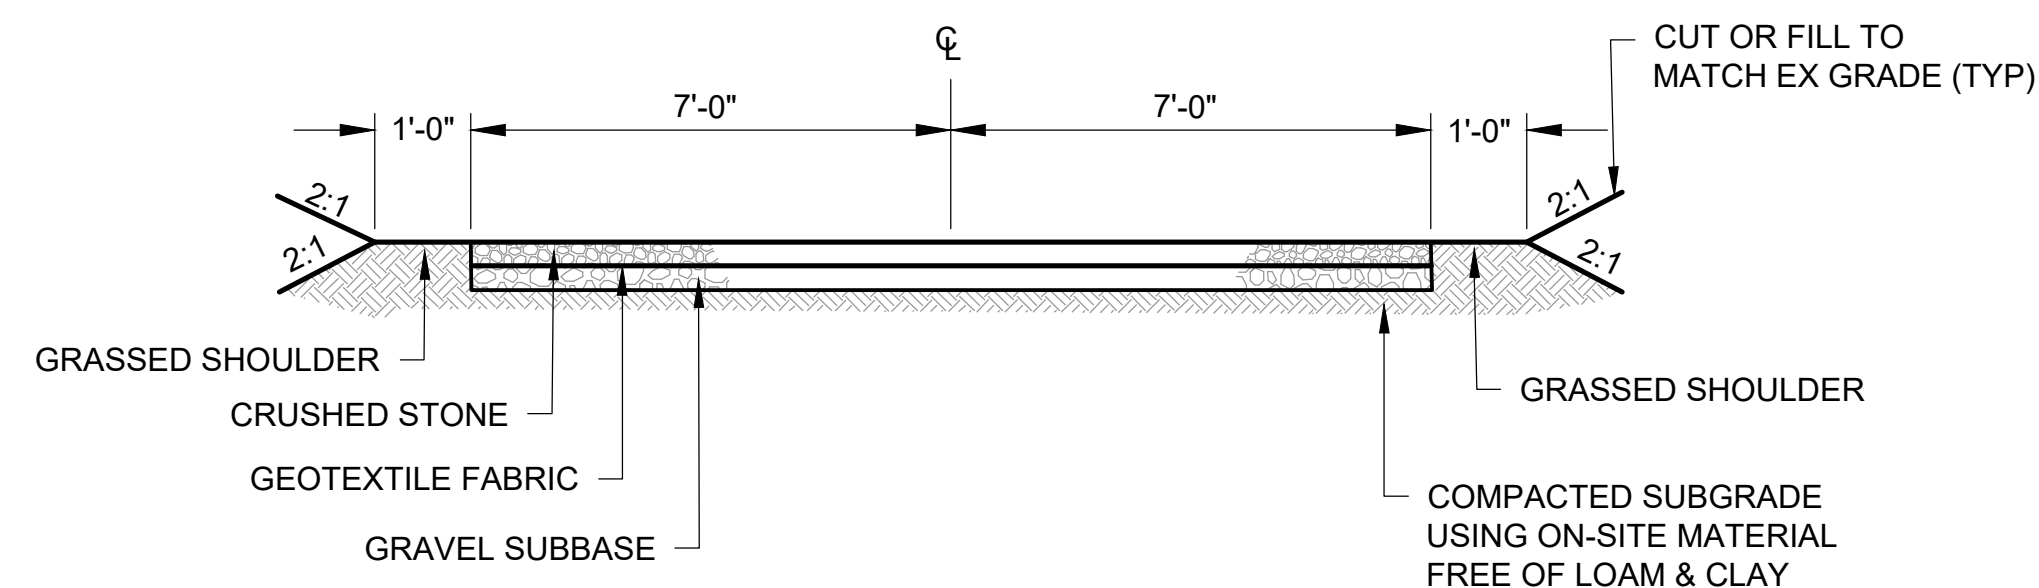


GRAVEL ROAD - TYPICAL SECTION 'A'

STA 0+00.00 - 0+05.00

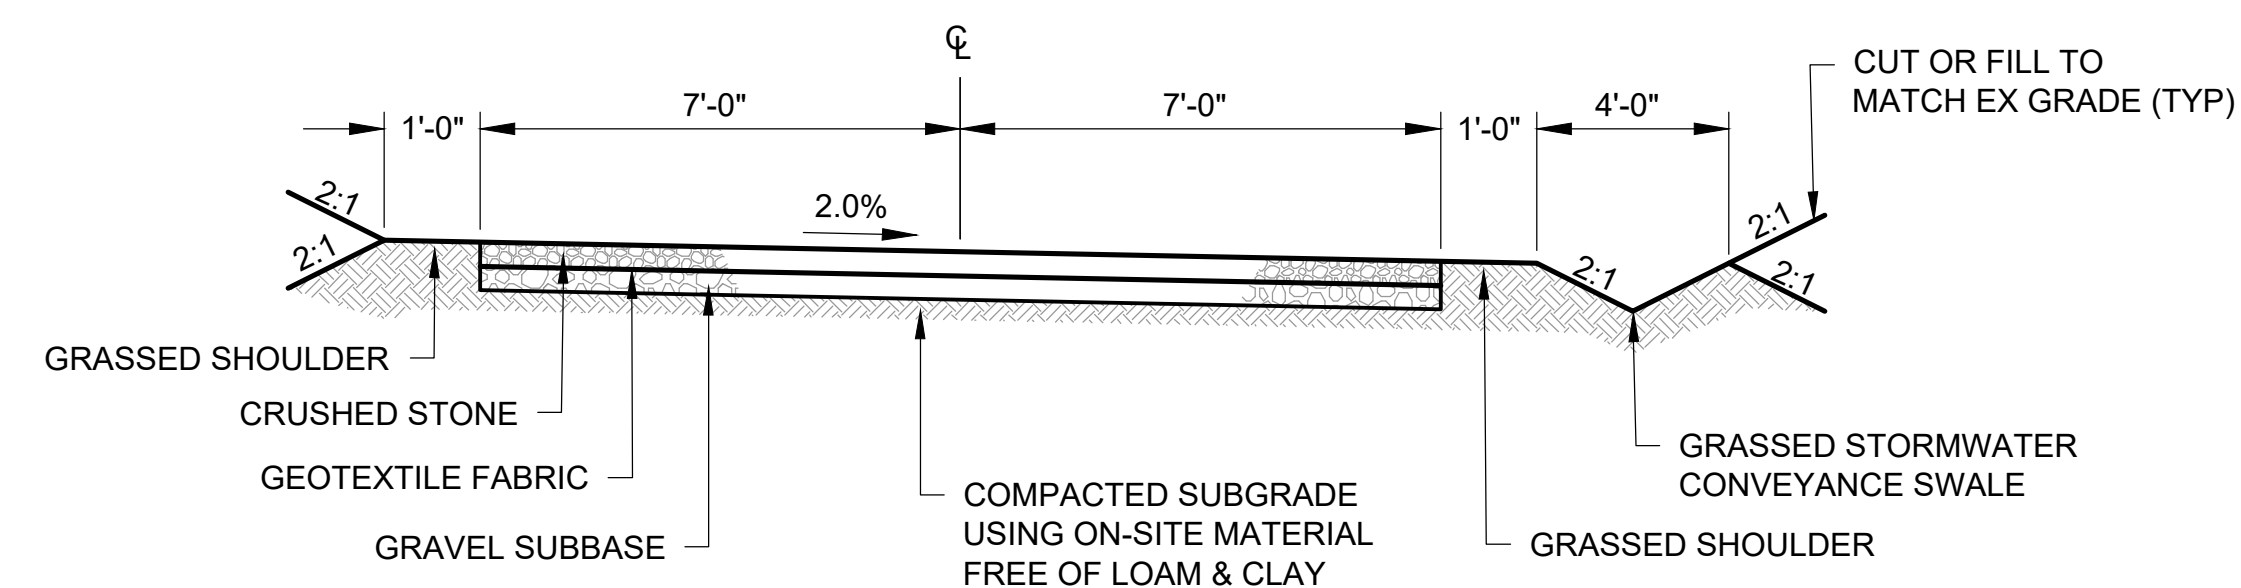


GRAVEL ROAD - TYPICAL SECTION 'B'

STA 0+05.00 - 6+90.36
STA 7+73.14 - 8+07.71

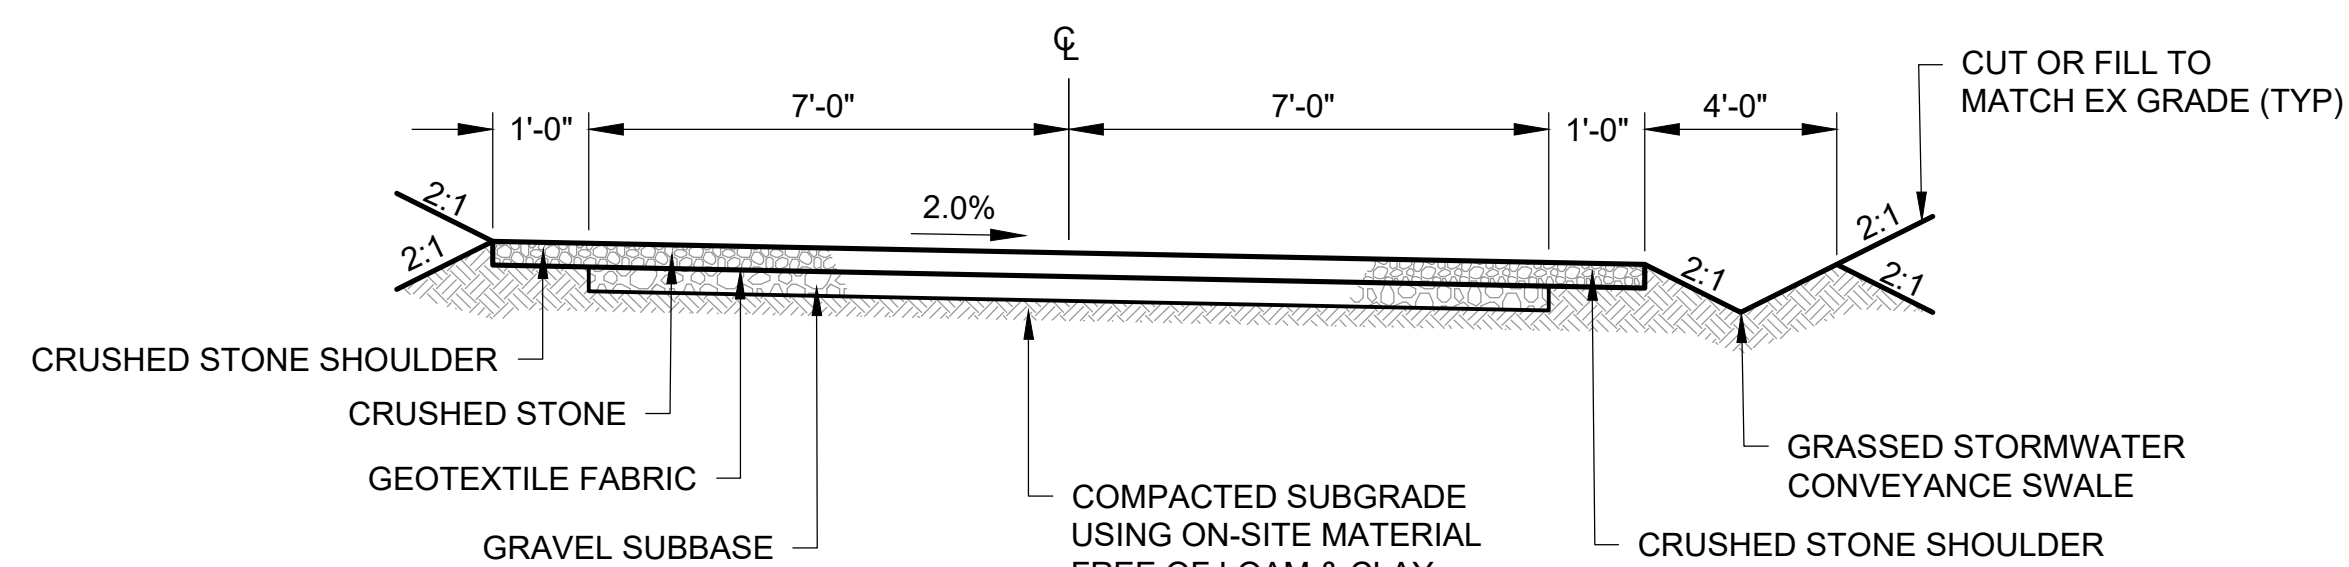

GRAVEL ROAD - TYPICAL SECTION 'C'

STA 6+90.36 - 7+73.14

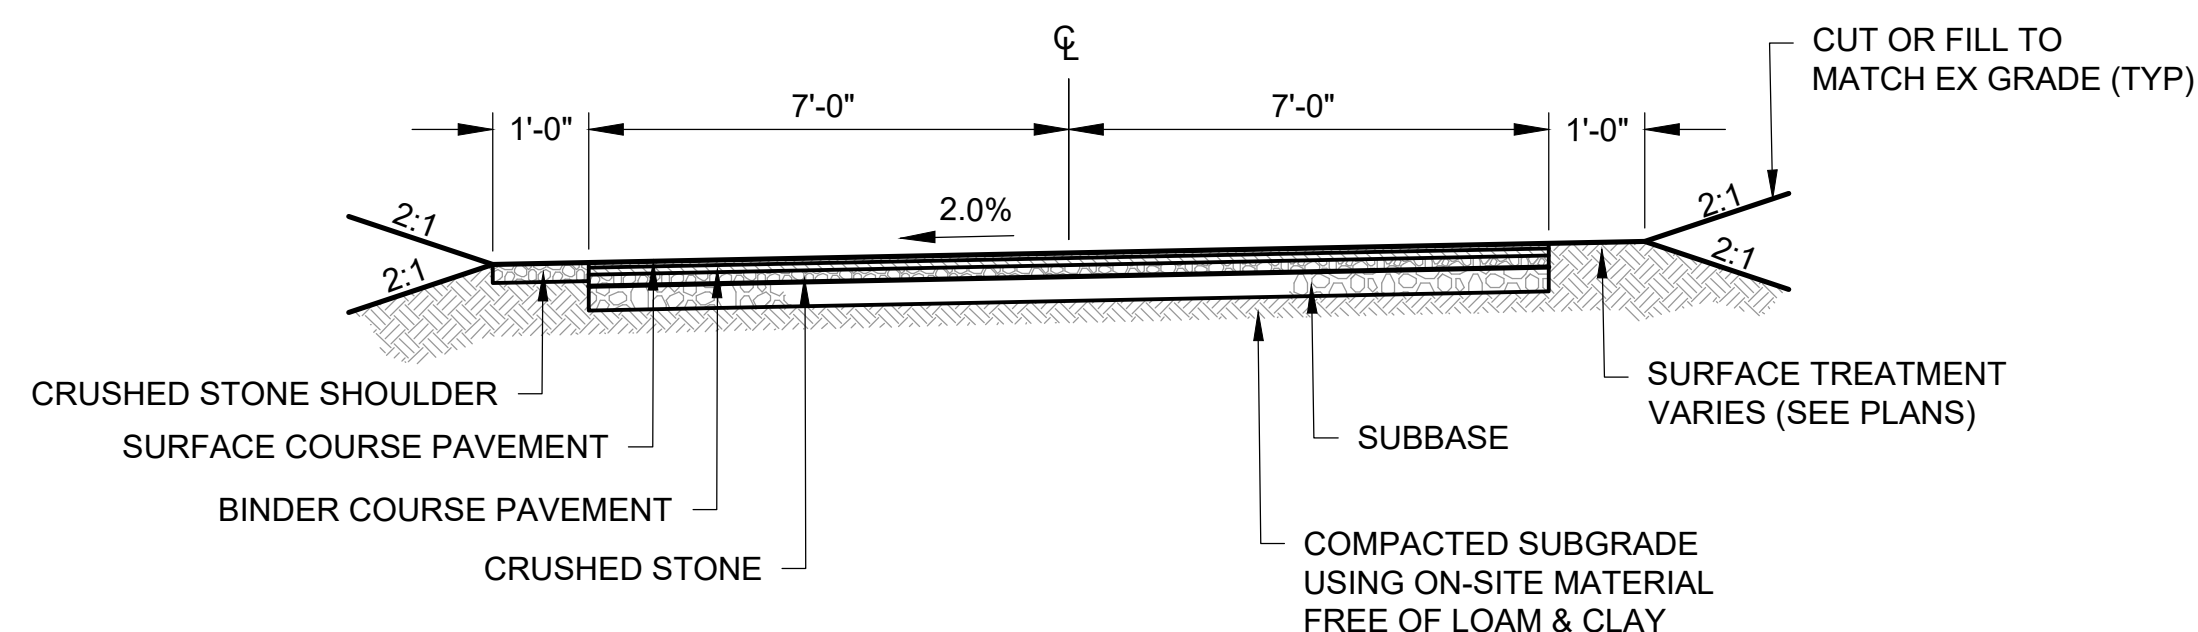

PAVED ROAD - TYPICAL SECTION 'E'


STA 9+97.25 - 11+96.61

NOTE:

1. SEE BITUMINOUS CONCRETE AND GRAVEL ACCESS ROADWAY CROSS-SECTIONS FOR INFORMATION ON MATERIAL DEPTHS AND ADDITIONAL REQUIREMENTS

ACCESS ROADWAY CROSS-SECTIONS


N.T.S.

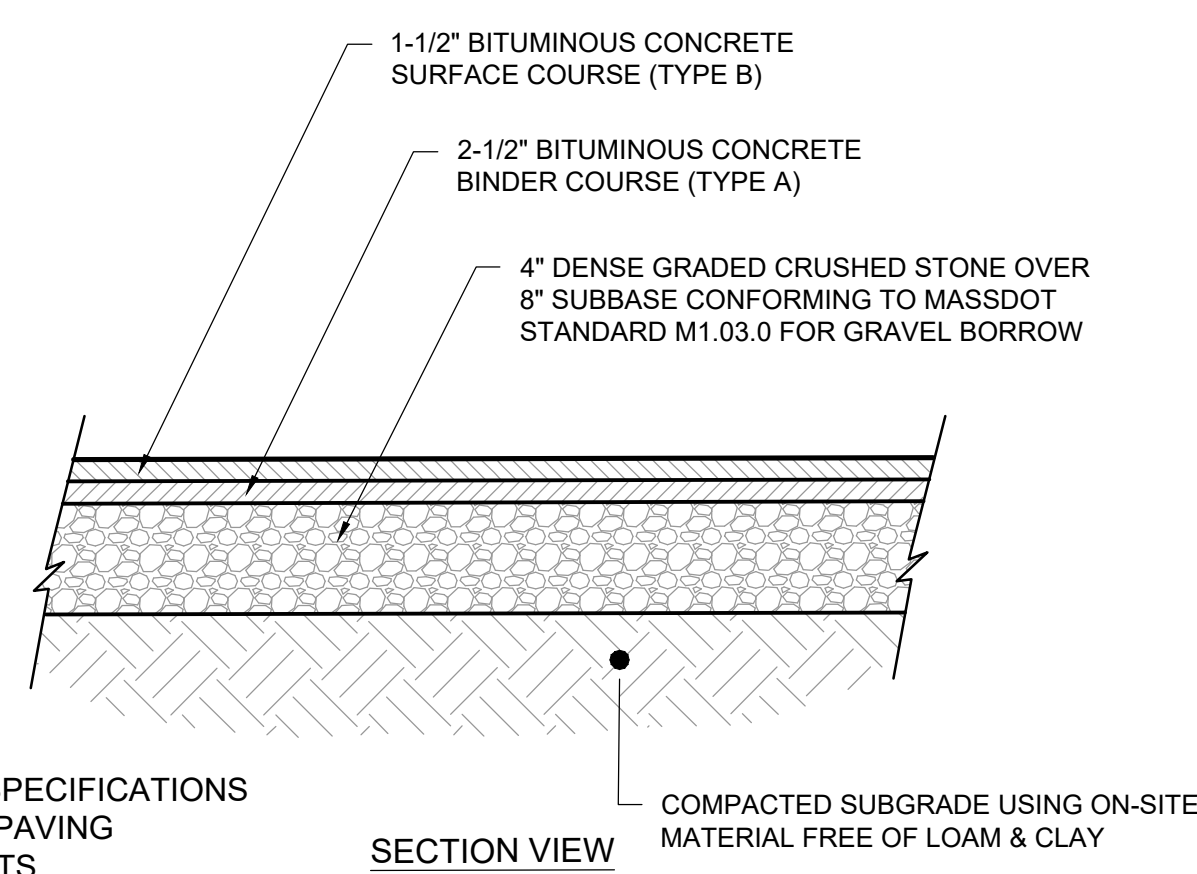

NOTE:
1. SEE HOT MIX ASPHALT SPECIFICATIONS
(SECTION 32 12 00) FOR PAVING
MATERIAL REQUIREMENTS.

BITUMINOUS CONCRETE ACCESS ROADWAY CROSS-SECTION


N.T.S.

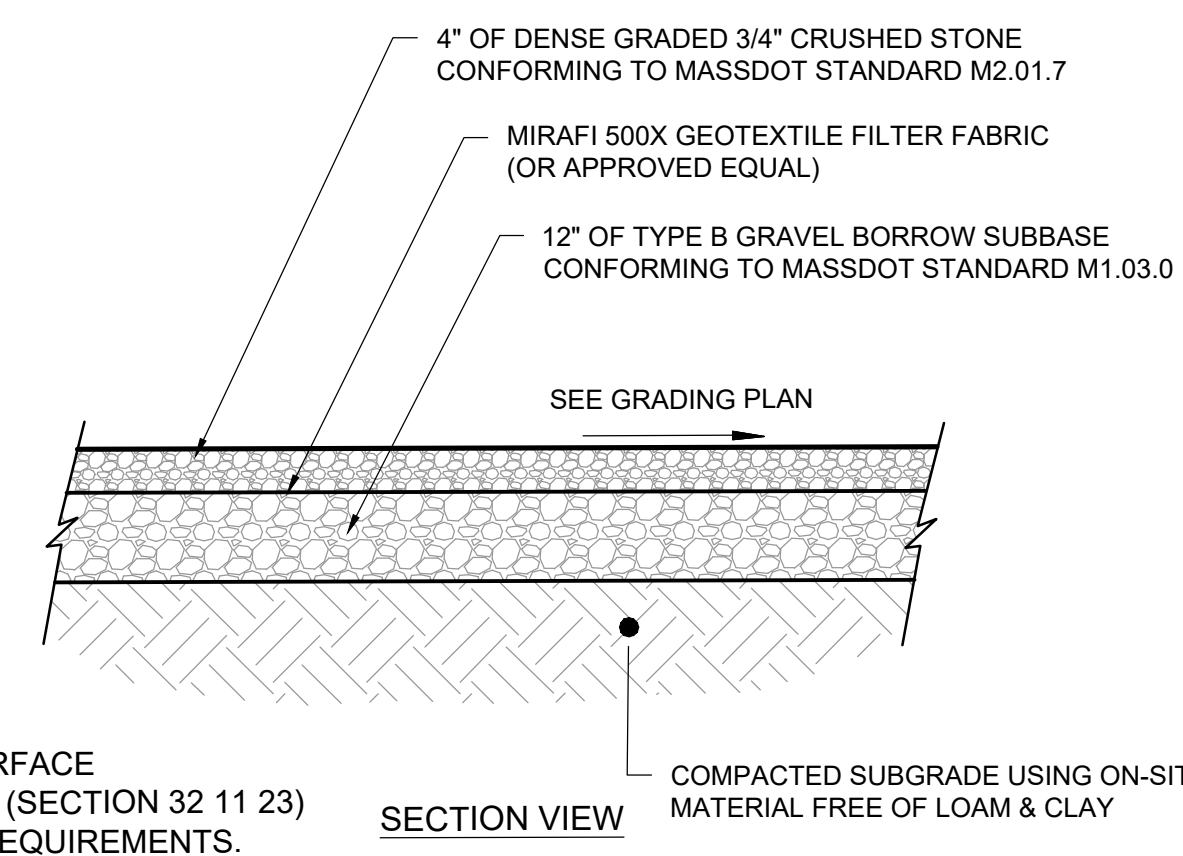

NOTE:
1. SEE GRAVEL SURFACE SPECIFICATIONS (SECTION 32 11 23) FOR MATERIAL REQUIREMENTS.

GRAVEL ACCESS ROADWAY CROSS-SECTION

N.T.S.

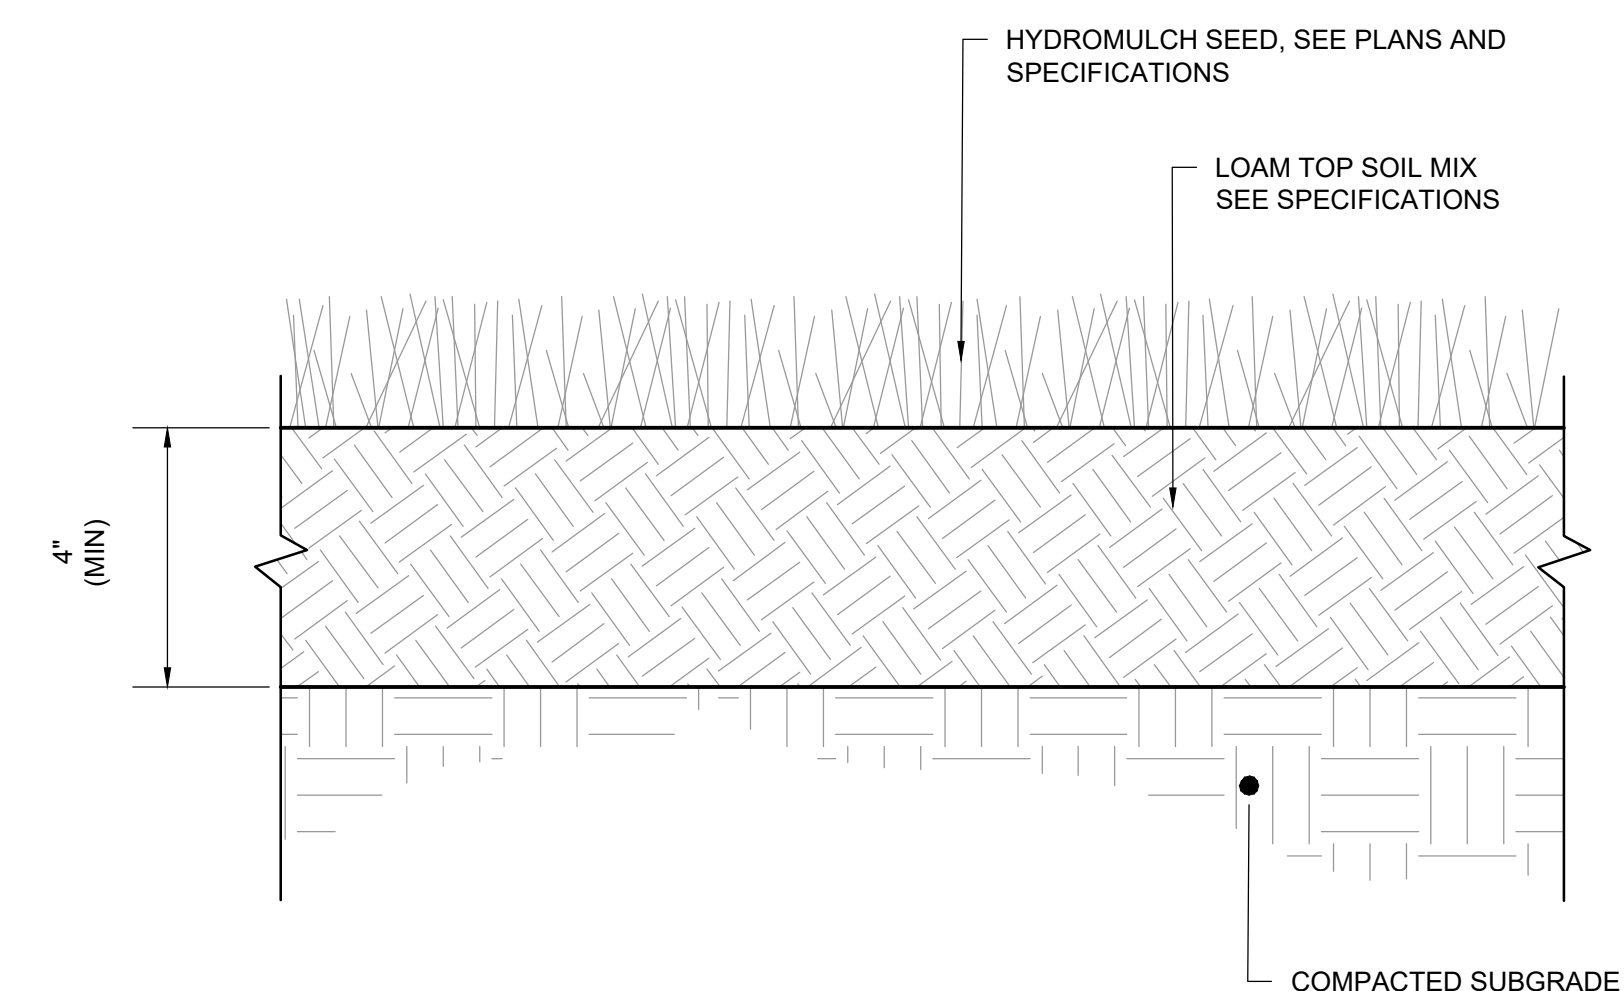

LOAM & SEED DETAIL

N.T.S.

Project:

LITTLETON WATER



TAYLOR STREET WELL AND
RAW WATER MAIN
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO.1

Weston & SampsonSM

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

[illegible]

COA:

Seal:



Issued For:

FOR PERMIT
REVIEW ONLY

Scale: AS NOTED

Date:	OCTOBER 2023
Drawn By:	GJK/RWS
Reviewed By:	SBR
Approved By:	TEM

W&S Project No.: ENG23-0679
W&S File No.:

Drawing Title:

DETAILS IV

Sheet Number:

C504

COPYRIGHT © 2022 WESTON & SAMPSON, INC.